



وزارة التعليم العالي والبحث العلمي  
الجامعة التقنية الشمالية  
المعهد التقني كركوك



# الحقية التعليمية

|                   |                        |
|-------------------|------------------------|
| القسم العلمي      | تقنيات ميكانيك القدرة  |
| اسم المقرر:       | اساسيات تكييف الهواء   |
| المرحلة / المستوى | المستوى الدراسي الثاني |
| الفصل الدراسي     | الاول                  |
| السنة الدراسية    | 2025/2024              |





## معلومات عامة

|                       |                                        |
|-----------------------|----------------------------------------|
| اساسيات تكييف الهواء  | اسم المقرر:                            |
| تقنيات ميكانيك القدرة | القسم:                                 |
| المعهد التقني كركوك   | الكلية:                                |
| الاول                 | المرحلة / المستوى                      |
| الأول                 | الفصل الدراسي:                         |
| 2   عملي              | عدد الساعات الاسبوعية:                 |
| 2   نظري              | عدد الوحدات الدراسية:                  |
| 4 وحدات               | الرمز:                                 |
| LMT101                | نوع المادة                             |
| ✓ كلاهما              | نظري                                   |
| عملي                  | هل يتوفر نظير للمقرر في الاقسام الاخرى |
| كلا                   | اسم المقرر النظير                      |
| /                     | القسم                                  |
| /                     | رمز المقرر النظير                      |

## معلومات تدريسي المادة

|                               |                           |
|-------------------------------|---------------------------|
| م . محمود حسين خليل           | اسم مدرس (مدرسي) المقرر:  |
| مدرس                          | اللقب العلمي:             |
| 2021                          | سنة الحصول على اللقب      |
| ماجستير /هندسة تقنية الحرارية | الشهادة :                 |
| 2014                          | سنة الحصول على الشهادة    |
| 10 سنة                        | عدد سنوات الخبرة ( تدريس) |

## الوصف العام للمقرر

ان مادة اساسيات تكييف الهواء هي جزء من هندسة تكييف الهواء الا ان هذه المادة تختص بالأنظمة الأساسية للتكييف منها الية انتقال الحرارة بين طبقات الجدران والسقوف وكذلك تأثير الاشعاع الشمسي وتبحث أيضا الأسس العامة للراحة البشرية ومفهوم الأداء الحركي للمراوح وتصنيف منظومات التكييف الخاصة بالتدفئة والخاصة بالتبريد وأسس تصميم مجاري الهواء.

### الاهداف العامة

- سيتمكن الطالب من التعريف بطبيعة انتقال الحرارة في طبقات الجدار والسقف و طرائق انتقال الحرارة.
- سيتعلم الطالب الأسس العامة للراحة البشرية و ماهي المعايير العالمية للحيز المكيف وتأثير شاغلي الحيز على الراحة البشرية
- سيتمكن الطالب من معرفة الأسس العامة لحساب وتصميم مجاري الهواء و الية ربط التصميم بالاحمال الحرارية
- سيتعلم الطالب تصميم واختيار المراوح الخاصة بانظمة التكييف وطرق صيانتها

### الأهداف الخاصة

- سيتعلم الطالب تأثير المصادر الحرارية على احمال التدفئة والتبريد
- سيتعلم الطالب طرق حساب الحرارة النافذة من والى الحيز في فصلي الشتاء والصيف
- سيتعلم الطالب اختيار التهوية المناسبة للحيز المكيف
- سيتعلم الطالب العلاقة بين سرعة المروحة ومعدل تدفقها والضغط الحركي للهواء
- سيتعلم الطالب تصميم مجاري الهواء بالطرق المشهورة من تقليل السرعة وهبوط الضغط المتساوي وغيرها

### الأهداف السلوكية او نواتج التعلم

- قادرا على تصميم أجهزة التكييف بشكل يتناسب مع الحمل الحراري للحيز
- قادرا على قراءة مخططات التكييف الخاصة بمجاري الهواء والعوامل المؤثرة على اداءها
- قادرا على اختيار وتنفيذ أنواع المراوح وما يتناسب مع التصميم العامة
- قادرا على تنظيم بيانات البناءات وتحديد الاتجاهات المثلى لها لتوفير من الطاقة المصروفة لأغراض التكييف

### المتطلبات السابقة

- لا يوجد

| الأهداف السلوكية او مخرجات التعليم الأساسية |                                                                                             |                                                                                                                                      |
|---------------------------------------------|---------------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------------------------------------------------------|
| ت                                           | الهدف                                                                                       | آلية التقييم                                                                                                                         |
| 1                                           | تصميم أجهزة التكييف بشكل يتناسب مع الحمل الحراري للحيز                                      | تعطى امثلة معمارية تحاكي المباني الخارجية و يطلب من الطالب استخدام الجداول الخاصة و القوانين و اجراء الحسابات اللازمة لتصميم الاجهزة |
| 2                                           | . قراءة مخططات التكييف الخاصة بمجاري الهواء والعوامل المؤثرة على اداءها                     | تدريب الطالب على قراءة المخطط وتحليله حسابيا واختيار تصميم يناسب الحالة و تدريبه على العوامل المؤثرة                                 |
| 3                                           | اختيار وتنفيذ أنواع المراوح وما يتناسب مع التصميم العامة                                    | اختبار الطالب بعدة امثلة على تتناسب مه تصميم المراوح                                                                                 |
| 4                                           | تنظيم بيانات البناءات و تحديد الاتجاهات المثلى لها لتوفير من الطاقة المصروفة لأغراض التكييف | اخذ امثلة عملية على البناءات وطريقة حساب الاحمال الحرارية لها بشكل عملي وتحديد الظروف المثالية للبناءة                               |

| أساليب التدريس |                                                                          |                                                                                     |
|----------------|--------------------------------------------------------------------------|-------------------------------------------------------------------------------------|
| ت              | الاسلوب او الطريقة                                                       | مبررات الاختيار                                                                     |
| 1              | الكتابة على السبورة ومشاركة الطالب بالأسئلة والأجوبة المباشرة            | اغلب مواضيع المادة طرائق حسابية وتحليلية تحتاج الى شرح الطريقة وتطبيقها على السبورة |
| 2              | اختبار الطالب بالمعلومات السابقة باختبار قبلي لاسترجاع المعلومات السابقة | معظم المادة متعلقة ببعضها فيجب اجبار الطالب على المراجعة                            |
| 3              | طرح الأمثلة القريبة من المواضيع ومشاركة الطالب في حلها                   | لتقريب الصورة وربط الواقع النظري بالواقع العملي الحقيقي للطالب                      |
| 4              | اخذ امثلة واقعية وتطبيق الحسابات عليها وحلها مع الطالب على شكل مجاميع    | لتدريب الطالب على التصميم وكسر حاجز الخوف من التطبيق الواقعي العملي                 |
| 5              | طلب واجبات بيتية وواجبات ميدانية من الطلبة لاختبار مدى الاستيعاب         | لاختبار مدى استيعاب الطالب للمعلومة وتشجيعه على محاولة حل المشكلة                   |

| الفصل الاول الى الفصل السادس      |        |        |                                                                                                                    |                                                                         |                                              |                                                                                       |
|-----------------------------------|--------|--------|--------------------------------------------------------------------------------------------------------------------|-------------------------------------------------------------------------|----------------------------------------------|---------------------------------------------------------------------------------------|
|                                   |        |        |                                                                                                                    | الوقت                                                                   |                                              | عنوان الفصل                                                                           |
| التوزيع الزمني                    | النظري | العملي | العنوان الفرعي/                                                                                                    | طريقة التدريس                                                           | التقنيات                                     | طرق القياس                                                                            |
| الأسبوع الأول                     | 2      | 2      | Heat transfer – heat transfer by conduction- heat transfer coefficient – heat transfer by convection and radiation | محاضرة مع مناقشة الطالب واختبارات قبلية                                 | سبورة + داتا شو + مخططات معلقة + عروض فديوية | اختبارات قبلية + مشاركات صفية ومناقشات + واجبات بيتية + امتحانات يومية وشهرية +تقارير |
| الأسبوع الثاني                    | 2      | 2      | Heat transfer through walls and composite walls – total heat transfer coefficient                                  |                                                                         |                                              |                                                                                       |
| الأسبوع الثالث والرابع            | 2      | 2      | Air conditioning – feeling comfortable – air movement – relative humidity – wet and bulb temperature               |                                                                         |                                              |                                                                                       |
| الأسبوع الخامس                    | 2      | 2      | Psychometric chart – sensible and latent heat - configuration of air leaving – heating and cooling coil            | محاضرة وتطبيق على المخططات وتقسيم الطلبة لمجموعات لحل الأمثلة التطبيقية | سبورة + داتا شو + مخططات معلقة + عروض فديوية | اختبارات قبلية + مشاركات صفية ومناقشات + واجبات بيتية + امتحانات يومية وشهرية +تقارير |
| الأسبوع السادس الى التاسع         | 2      | 2      | Air duct designing – types and pressure losses calculation methods- fittings                                       |                                                                         |                                              |                                                                                       |
| الأسبوع العاشر                    | 2      | 2      | Movement energy – air discharge in room                                                                            | محاضرة مع مناقشة الطالب واختبارات قبلية                                 | سبورة + داتا شو + مخططات معلقة + عروض فديوية | اختبارات قبلية + مشاركات صفية ومناقشات + واجبات بيتية + امتحانات يومية وشهرية +تقارير |
| الأسبوع الحادي عشر الى الثاني عشر | 2      | 2      | Fans – fan laws – specification                                                                                    | محاضرة وتطبيق على المخططات وتقسيم الطلبة لمجموعات لحل الأمثلة التطبيقية |                                              |                                                                                       |
| الأسبوع الثالث عشر                | 2      | 2      | Vibration and vibration source                                                                                     | محاضرة مع مناقشة الطالب واختبارات قبلية                                 | سبورة + داتا شو + مخططات معلقة + عروض فديوية | اختبارات قبلية + مشاركات صفية ومناقشات + واجبات بيتية + امتحانات يومية وشهرية +تقارير |
| الأسبوع الرابع عشر                | 2      | 2      | Air washers                                                                                                        |                                                                         |                                              |                                                                                       |
| الأسبوع الخامس عشر                | 2      | 2      | Energy distribution in air conditioning systems                                                                    |                                                                         |                                              |                                                                                       |

# المحتوى العلمي

## خارطة القياس المعتمدة

| عدد الفقرات | الأهداف السلوكية |         |         |       |         |        | الأهمية النسبية | عناوين الفصول                                                                                                     | المحتوى التعليمي                  |
|-------------|------------------|---------|---------|-------|---------|--------|-----------------|-------------------------------------------------------------------------------------------------------------------|-----------------------------------|
|             | التقييم          | التحليل | التطبيق | الفهم | المعرفة |        |                 |                                                                                                                   |                                   |
|             |                  |         |         |       | %20     | النسبة |                 |                                                                                                                   |                                   |
| %30         | %15              | %25     | %10     |       |         |        |                 |                                                                                                                   |                                   |
| 4           | 1٠22             | 1       | 1٠2     | 1     | 1       |        | %6.61           | Heat transfer – heat transfer by conduction-heat transfer coefficient – heat transfer by convection and radiation | الأسبوع الأول                     |
| 6           | 1٠78             | 1       | 1٠5     | 1     | 1       |        | %6.61           | Heat transfer through walls and composite walls – total heat transfer coefficient                                 | الأسبوع الثاني                    |
| 7           | 2٠06             | 1       | 1٠5     | 1     | 2       |        | %13.25          | Air conditioning – feeling comfortable – air movement – relative humidity – wet and bulb temperature              | الأسبوع الثالث والرابع            |
| 9           | 2٠22             | 1       | 2٠2     | 1     | 2       |        | %6.61           | Psychometric chart – sensible and latent heat - configuration of air leaving – heating and cooling coil           | الأسبوع الخامس                    |
| 11          | 2٠32             | 2       | 2٠3     | 2     | 2       |        | %26.5           | Air duct designing – types and pressure losses calculation methods- fittings                                      | الأسبوع السادس الى التاسع         |
| 13          | 2٠40             | 2       | 3٠3     | 2     | 2       |        | %6.61           | Movement energy – air discharge in room                                                                           | الأسبوع العاشر                    |
| 7           | 2٠06             | 1       | 1٠5     | 1     | 2       |        | %13.25          | Fans – fan laws – specification                                                                                   | الأسبوع الحادي عشر الى الثاني عشر |
| 4           | 1٠22             | 1       | 1٠2     | 1     | 1       |        | %6.61           | Vibration and vibration source                                                                                    | الأسبوع الثالث عشر                |
| 4           | 1٠22             | 1       | 1٠2     | 1     | 1       |        | %6.61           | Air washers                                                                                                       | الأسبوع الرابع عشر                |
| 4           | 1٠22             | 1       | 1٠2     | 1     | 1       |        | %6.61           | Energy distribution in air conditioning systems                                                                   | الأسبوع الخامس عشر                |
| 50          | 12               | 8       | 12      | 8     | 10      |        | 100             |                                                                                                                   | المجموع                           |

## المحتويات

| رقم المحاضرة: الاولى               | عنوان المحاضرة:                                                                                                                                            |
|------------------------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------|
| Heat transfer                      |                                                                                                                                                            |
| اسم المدرس:                        | محمود حسين خليل                                                                                                                                            |
| الفئة المستهدفة:                   | طلبة المعهد التقني / قسم تقنيات ميكانيك القدرة                                                                                                             |
| الهدف العام من المحاضرة :          | التعرف على طرائق انتقال الحرارة في الاجسام الأحادية و المركبة                                                                                              |
| الأهداف السلوكية او مخرجات التعلم: | 1- سيكون الطالب ملماً بقوانين انتقال الحرارة<br>2- سيتعلم طريقة حساب معامل انتقال الحرارة الاجمالي<br>3- حساب الطاقة الحرارية المنتقلة عبر الجدران والسقوف |
| استراتيجيات التيسير المستخدمة      | السبورة و الداتا شو و استخدام القوانين و الجداول                                                                                                           |
| المهارات المكتسبة                  | تحليل و حل الأسئلة الخاصة بالجدران والسقوف و اختيار المناسب منها مع التطبيقات العملية                                                                      |
| طرق القياس المعتمدة                | اختبار قبلي و مناقشات و تقييم مشاركات الطالب و اختبار بعدي و اختبار نهاية الفصل                                                                            |

## الأسئلة القبلية

- س1 / ما الفرق بين الطاقة الحرارية و درجة الحرارة و مقياس الحرارة ؟
- س2/ ما هو تصورك عن سبب انتقال الحرارة بالتوصيل للاجسام الصلبة؟
- س3/ ما هو السبب في تكون تيارات الحمل الحراري للهواء او الغازات ؟

\*\*\*\*\*

## Chapter One الفصل الاول

### Heat Transfer انتقال الحرارة

**1- Heat Transfer:** is the science that deals with energy (Heat) transfer between two bodies as a result of temperature difference.

Heat-transfer can be described in three modes:

- Conduction, التوصيل
- Convection, الحمل
- Radiation, الاشعاع

#### 1-1 Conduction التوصيل :

Is the mechanism of heat transfer in solid material, such as through walls and roofs.

Fourier's law (قانون فوريير) gives the following relationship:

$$q = -K A \frac{\Delta T}{\Delta x}$$

Where:

Q: heat transfer "Watt"

K: thermal conductivity "W/m °C"

A: cross-sectional area normal to heat flow "m<sup>2</sup>"

T: temperature "°C"

Δx: thickness along heat flow "m"

For steady-state heat conduction through a **plane wall for one layer**, as shown in Fig.??, the rate of heat transfer through the section From Fourier's law of conduction,

$$q = -K A \frac{T_2 - T_1}{\Delta x} = \frac{T_1 - T_2}{\frac{\Delta x}{KA}}$$

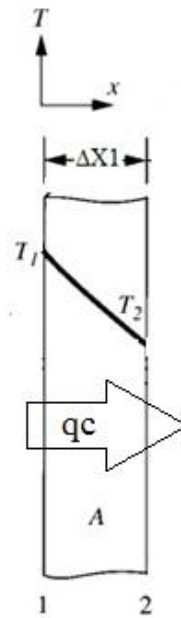


Figure 1-1 heat transfer through single layer wall

$$q = \frac{T_1 - T_2}{\frac{\Delta x}{KA}} \leftrightarrow q = \frac{T_1 - T_2}{R_{th}}$$

Where :

$R_{th} = \frac{\Delta x}{KA}$  : Thermal resistance for conduction heat transfer "m. °C/watt"

For steady-state heat conduction through a plane composite wall with perfect thermal contact between each layer, as shown in Fig. ?? the rate of heat transfer through each section of the **composite wall must be the same**. From Fourier's law of conduction,

$$q_{conduction} = -K_A A \frac{\Delta T_A}{\Delta x_1} = -K_B A \frac{\Delta T_B}{\Delta x_2} = -K_C A \frac{\Delta T_C}{\Delta x_3}$$

$$R_{th.total} = R_1 + R_2 + R_3 + \dots R_n$$

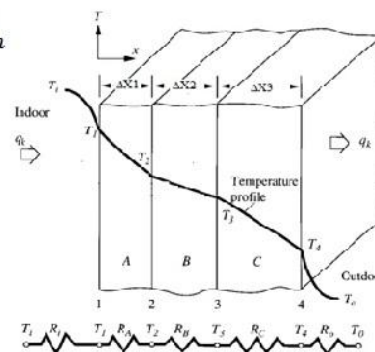


Figure 1-2 heat transfer through composite wall

## 1-2 Convection الحمل:

It occurs when a fluid comes in contact with a surface at a different temperature, Convective heat transfer can be **divided into two types: forced** convection and **natural** or **free** convection.

### 1-2-a-Natural or free convection الحمل الحر او الطبيعي:

The motion of the fluid is caused by the density difference of the fluid when contacting surface at a different temperature.

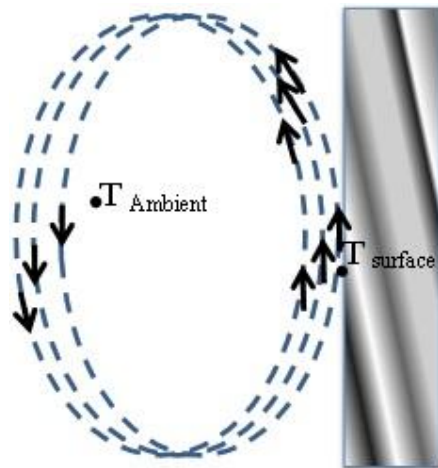


Figure 1-3 heat transfer by natural convection

### 1-2-b- Forced convection الحمل الحراري القسري:

fluid is forced to move along the surface by an outside motive force, heat is transferred by forced convection.

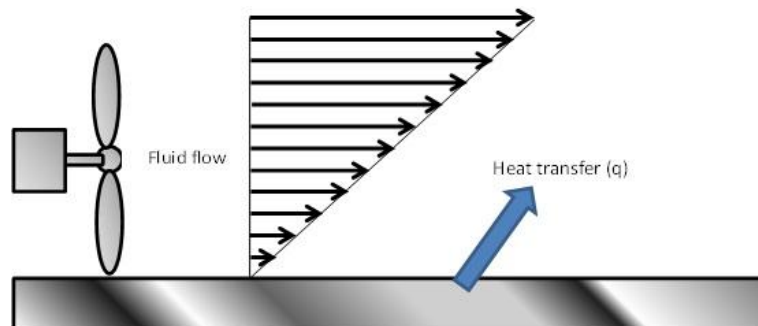


Figure 1-4 heat transfer by forced convection

By expressing Newton law for cooling:

$$q_{convection} = h.A.(T_1 - T_2)$$

Where :

$h$  : convection heat transfer coefficient " W/m<sup>2</sup>.°C"

### 1-3 Overall Heat Transfer Coefficients (U) معامل انتقال الحرارة الاجمالي (الكلي):

In actual practice, many calculations of heat-transfer rates are combinations of conduction, convection, and radiation.

Consider the composite wall shown in Fig. 3.1; in addition to the conduction through the wall, convection and radiation occur at inside and outside surfaces 1 and 4 of the composite wall. At the inside surface of the composite wall, the rate of heat transfer  $q_i$  (W):

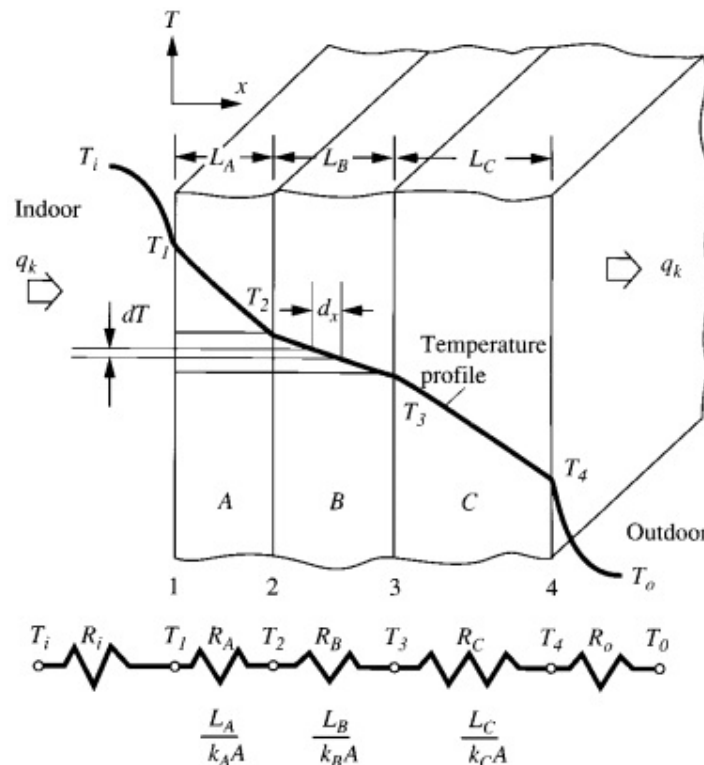


Figure 1-5 heat transfer by convection and conduction method through composite wall

$$q_k = \frac{T_1 - T_2}{\frac{1}{A} \left[ \frac{1}{h_i} + \frac{L_A}{k_A} + \frac{L_B}{k_B} + \frac{L_C}{k_C} + \frac{1}{h_o} \right]} \Leftrightarrow q_k = UA(T_1 - T_2)$$

$$U = \frac{1}{\frac{1}{h_i} + \frac{L_A}{k_A} + \frac{L_B}{k_B} + \frac{L_C}{k_C} + \frac{1}{h_o}} \text{ Overall heat transfer coefficient " W/m}^2\text{.}^\circ\text{C"}$$

### 1-3 Radiation الاشعاع:

the heat transfer in radiation by electromagnetic waves.

$$q_r = \sigma A (T^4)$$

$\sigma$  : Stefan-Boltzman constant =  $5.66 \times 10^{-8} \text{ W/m}^2\text{.K}$


الاسئلة البعدية

Sheet No.1

Q1/ A certain building wall consist of (0.15m) concrete ( $K=1.2 \text{ w/m.}^\circ\text{C}$ ) , (0.005m) of fiber glass insulation ( $K= 0.048 \text{ w/m.}^\circ\text{C}$ ) and (10mm) of gypsum board ( $K=0.005 \text{ w/m.}^\circ\text{C}$ ) , the inside and outside convection coefficients are (10 and 40) respectively. Calculate the overall heat transfer coefficient for wall

Q2/ in the previous question if one side exposed to air at ( $30^\circ\text{C}$ ) and the other side exposed to air at ( $18^\circ\text{C}$ ) . Calculate quantity of heat transfer for wall dimension ( $4.2\text{m} \times 2.9\text{m}$ ) .

Q3/ Calculate the heat transfer coefficient for the wall shown in figure below:

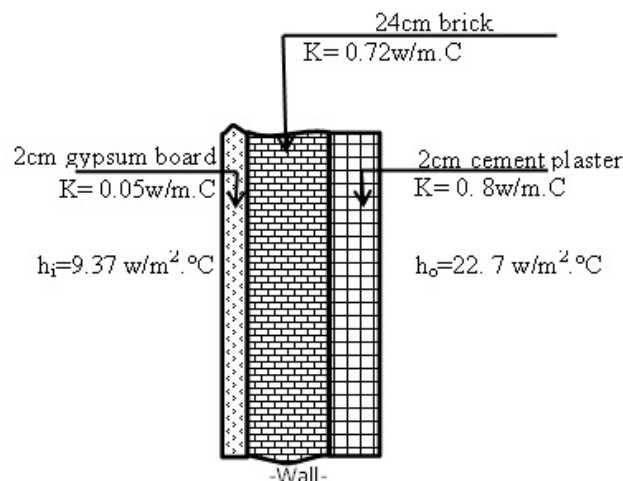

#### References:

- Y. A. Cengel and A. J. Ghajar, "Heat and Mass Transfer (in SI Units)." McGraw-Hill Education-Europe, London, 2014.  
J. P. Holman, *Heat Transfer (Si Units) Sie*. Tata McGraw-Hill Education, 2008.

## المحتويات

|                                    |                                                                                                                                                 |
|------------------------------------|-------------------------------------------------------------------------------------------------------------------------------------------------|
| رقم المحاضرة: الثانية              |                                                                                                                                                 |
| عنوان المحاضرة:                    | Fans                                                                                                                                            |
| اسم المدرس:                        | محمود حسين خليل                                                                                                                                 |
| الفئة المستهدفة:                   | طلبة المعهد التقني / قسم تقنيات ميكانيك القدرة                                                                                                  |
| الهدف العام من المحاضرة :          | التعرف على أنواع المراوح المستخدمة في تكييف الهواء                                                                                              |
| الأهداف السلوكية او مخرجات التعلم: | 1- سيكون الطالب ملماً بقوانين المراوح<br>2- سيتعلم طريقة تصميم المراوح<br>3- سيتعلم طريقة تحليل و حساب فقدان الضغط وتوزيع السرعة وكفاءة المراوح |
| استراتيجيات التيسير المستخدمة      | السبورة و الداتا شو و استخدام المخططات                                                                                                          |
| المهارات المكتسبة                  | تحليل و حل الأسئلة الخاصة بالمراوح و اختيار المناسب منها مع التطبيقات العملية                                                                   |
| طرق القياس المعتمدة                | اختبار قبلي و مناقشات و تقييم مشاركات الطالب و اختبار بعدي و اختبار نهاية الفصل                                                                 |

## الأسئلة القبليّة

س1 / ماهي أنواع المراوح ؟

س2/ مانوع الطاقات التي تضيفها المروحة للهواء ؟

س3/ ماهو سبب استهلاك المروحة للطاقة وهل يمكن ان تكون كفاءتها عالية؟


\*\*\*\*\*

## Chapter Two /Fans

**Fans:** the equipment that propel air or other gas for air-conditioning applications.

There are four types of fans:

- 1) Centrifugal fan    2) Axial flow fan    3) Tube axial fan    4) Propeller fan

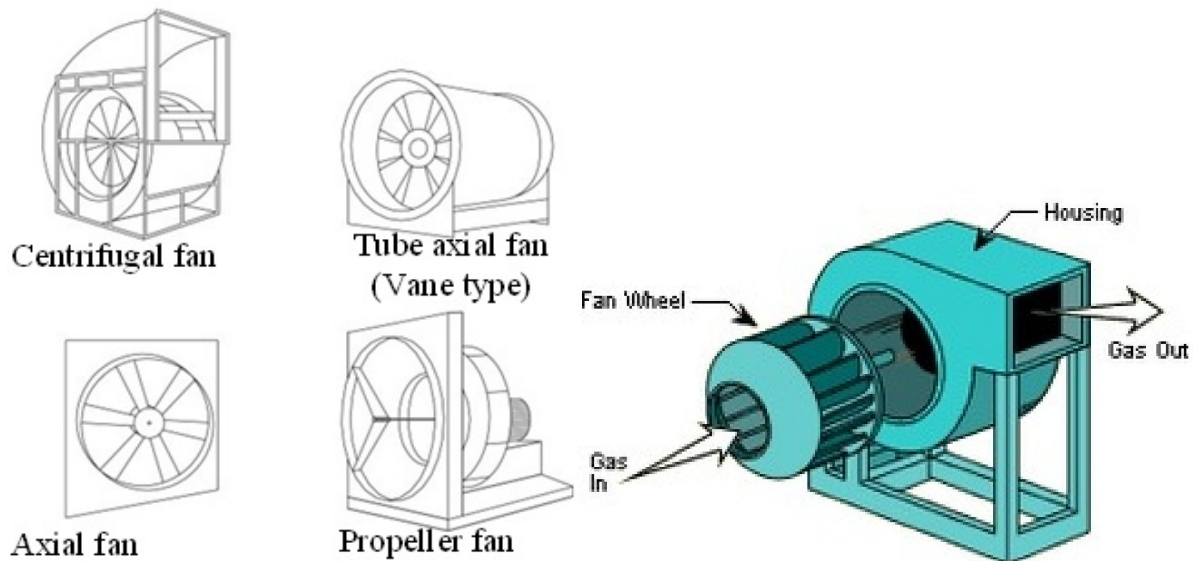

## Axial Flow Fans

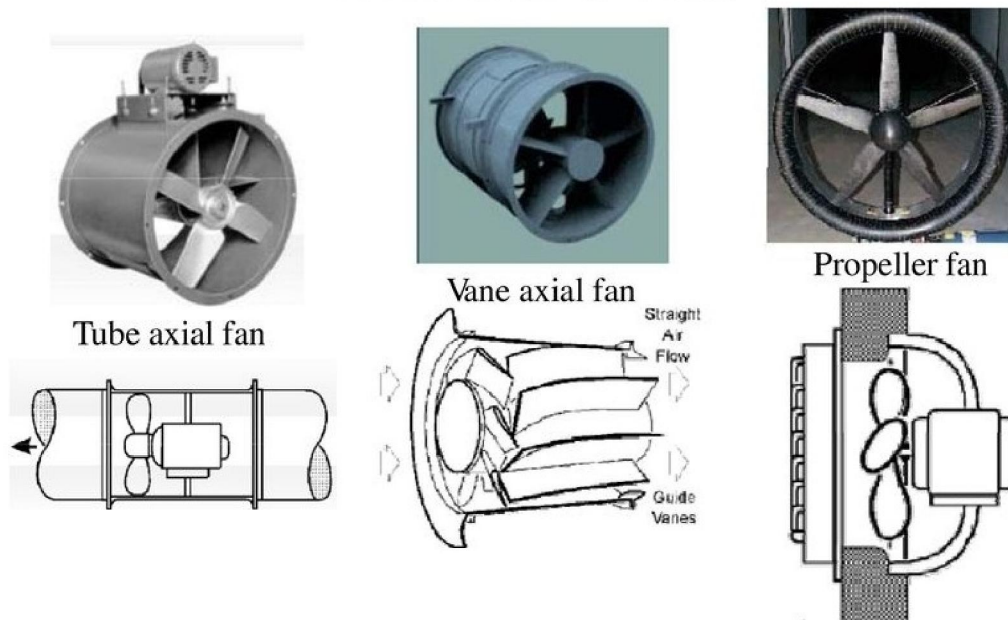


Figure 7-1 types of fans

**Air power:** - the amount of total pressure the fan can give to the air.

$$W_a = V_s \times P_t \dots \dots \dots (6-1)$$

Where: -  $W_a$  = Air power "watt"

$V_s$  = volumetric air flow rate "m<sup>3</sup>/sec" and  $P_t$  = total pressure "N/m<sup>2</sup> or Pa"

**Fan efficiency( $\eta$ )** : It is the ratio of air power to the fan power .

$$\eta = \frac{\text{Air power}}{\text{Fan power}} = \frac{W_a}{W_f} \dots \dots \dots (6-2)$$

Where: -  $W_f$  = Fan power "watt"

**Fan static efficiency ( $\eta_s$ )**: It is the ratio of static air power to the fan power.

$$\eta_s = \frac{W_{a.s}}{W_f} = \frac{V_s \times P_s}{W_f} \dots \dots \dots (6-3)$$

Where: -  $W_{a.s}$  = Static air power "watt"

$P_s$  = Static Pressure N/m<sup>2</sup> "Pa"

$$P_v = \frac{1}{2} \times \rho \times V^2 \quad \text{and} \quad P_t = P_s + P_v$$

Where: -  $P_v$  = velocity pressure or dynamic pressure

\*\*\*\*\*

**Example :-** Fan with 0.65 efficiency draw air from a room and propel it induct , air flow rate in the duct (1m<sup>3</sup>/sec), static pressure drop in the duct (140.25 N/m<sup>2</sup>) , air velocity in duct (13m/sec); find 1 air power and 2 fan power [take :  $\rho_{\text{air}} = 1.2 \text{ kg/m}^3$ ]

**Solution:**

$$P_v = \frac{1}{2} \times \rho \times V^2 = \frac{1}{2} \times 1.2 \times (13)^2 = 101.4 \text{ Pa}$$

$$P_t = P_s + P_v = 140.25 + 101.4 = 241.65 \text{ Pa}$$

$$W_a = V_s \times P_t = 1 \times 241.65 = 241.65 \text{ watt}$$

$$\eta = \frac{W_a}{W_f} \rightarrow W_f = \frac{W_a}{\eta} = \frac{241.65}{0.65} = 371.8 \text{ watt}$$

**Fan laws:-**

A / For given Fan size, ducting system air density:-

في حالة ثبوت درجة الحرارة للهواء (اي ثبوت كثافة الهواء) و تغير السرعة :-

$$\frac{V_{s1}}{V_{s2}} = \frac{N_1}{N_2} \dots\dots\dots(6-5)$$

$$\frac{P_1}{P_2} = \left(\frac{N_1}{N_2}\right)^2 \dots\dots\dots(6-6)$$

$$\frac{W_{f1}}{W_{f2}} = \left(\frac{N_1}{N_2}\right)^3 \dots\dots\dots(6-7)$$

**B/** for a given fan size, Ducting system and speed, if density change:-

في حالة ثبوت السرعة و تغير درجة الحرارة للهواء (اي تغير في كثافة الهواء):-

$$V_{s1} = V_{s2} \dots\dots\dots(6-8)$$

$$\frac{P_1}{P_2} = \frac{\rho_1}{\rho_2} \dots\dots\dots(6-9)$$

$$\frac{W_{f1}}{W_{f2}} = \frac{\rho_1}{\rho_2} \dots\dots\dots(6-10)$$

**Example :-** fan propel 8.2 m<sup>3</sup>/sec with static pressure 250 Pa when its speed 256 r.p.m of the power absorbed equal (3.4 kw) , if fan speed changed to 300 r.p.m , find air flow rate ,static pressure and power absorbed.

**Solution:**

$$\frac{V_{s1}}{V_{s2}} = \frac{N_1}{N_2} \rightarrow \frac{8.2}{V_{s2}} = \frac{256}{300} \rightarrow V_{s2} = 9.6 m^3/sec$$

$$\frac{P_{s1}}{P_{s2}} = \left(\frac{N_1}{N_2}\right)^2 \rightarrow \frac{250}{P_{s2}} = \left(\frac{256}{300}\right)^2 \rightarrow P_{s2} = 343.3 Pa$$

$$\frac{W_{f1}}{W_{f2}} = \left(\frac{N_1}{N_2}\right)^3 \rightarrow \frac{3.4}{W_{f2}} = \left(\frac{256}{300}\right)^3 \rightarrow W_{f2} = 5.5 Kw$$

**Example :-** Fan rotates with 1500 r.p.m , supply air with (140 m<sup>3</sup>/min) at 15°C and 75mm water total pressure when its efficiency 86% , find air flow rate , total pressure and power consumed for the following cases:-

A/ When air temperature become (increase to) 50°C.

B/Air temperature remain at 50 °C but the fan speed increase to 1700 r.p.m

Note// take air density change by  $\frac{\rho_1}{\rho_2} = 1.12$

### Solution:

A/ T=increase from 15 to 50 °C

$$\frac{P_{t1}}{P_{t2}} = \frac{\rho_1}{\rho_2} \rightarrow \frac{75}{P_{t2}} = 1.12 \rightarrow P_{t2} = 67 \text{ mm H}_2\text{O}$$

$$W_{a2} = V_{s2} \times P_{t2}$$

$$P_{t2} = \rho \times g \times h_2 = 1000 \times 9.81 \times \frac{67}{1000} = 657.27 \text{ Pa}$$

$$W_{a2} = 657.27 \times \frac{140}{60} = 1533.63 \text{ watt}$$

$$\eta = \frac{W_{a2}}{W_{f2}} \rightarrow W_{f2} = \frac{W_{a2}}{\eta} = \frac{1533.63}{0.86} = 1783.23 \text{ watt}$$

B/ fan speed increase from 1500 to 1700 r.p.m

$$\frac{V_{s2}}{V_{s3}} = \frac{N_2}{N_3} \rightarrow \frac{140}{V_{s3}} = \frac{1500}{1700} \rightarrow V_{s3} = 158.7 \frac{\text{m}^3}{\text{min}}$$

$$\frac{P_{t2}}{P_{t3}} = \left(\frac{N_2}{N_3}\right)^2 \rightarrow \frac{67}{P_{t3}} = \left(\frac{1500}{1700}\right)^2 \rightarrow P_{t3} = 86 \text{ mm H}_2\text{O}$$

$$\frac{W_{f2}}{W_{f3}} = \left(\frac{N_2}{N_3}\right)^3 \rightarrow \frac{1783.23}{W_{f3}} = \left(\frac{1500}{1700}\right)^3 \rightarrow W_{f3} = 2595.85 \text{ watt}$$

الاختبار البعدي

## Sheet No 2

Q1/ An air conditioning supply fan is operating at (600 r.p.m )against (500 pa) static pressure and requiring(4.85 Kw).It is delivering (540 m<sup>3</sup>/min) at standard conditions. In order to handle air conditioning load ,more air is desired .in order to increase flow to (610 m<sup>3</sup>/min ) what are the new speed ,static pressure and power?

Q2/ A fan delivers (230 m<sup>3</sup>/min) of air having density of (1.2 kg/m<sup>3</sup>) against a static pressure of (500Pa) when the speed is (600 r.p.m ) and the power input (3.7 kw) .if the inlet air temperature is changed such that anew density is (9.63) at the same fan speed what is the new flow rate, static pressure and power?

Q3/ A centrifugal fan (910mm) diameter operate at (8.0r.p.s) when handling air at a temperature of (20°C) with a corresponding total pressure development of (600 N/m<sup>2</sup>) and shaft power is (3Kw) .if the fan is used for heating purpose and fan handles air at a temperature (50°C) , calculate the total pressure developed and fan power under these new condition?

Q4/the following data is available from a test report of a centrifugal fan volume flow rate (3m<sup>3</sup>/sec) , fan power(2.6 kw) , fan static pressure (524 Pa) , fan discharge area (0.3m<sup>2</sup>) calculate air power and efficiency ? Take ( $\rho_{\text{air}}=1.2\text{kg/m}^3$ ).

Q5/ A fan delivers (280m<sup>3</sup>/min) of air against a static pressure of (500Pa) , when the speed is (500r.p.m) and power input is (4.5kw) . What speed, static pressure will be obtained for delivery of (400m<sup>3</sup>/min)

### References

W. P. Jones, *Air conditioning application and design*. Routledge, 2012.

B. J. Burley and others, “An update on ANSI/ASHRAE standard 62.1,” *Ashrae J.*, vol. 64, no. 9, pp. 28–30, 2022.

V. V. P. Bharathi, A. Kodliwad, B. A. Kumar, and V. V. N. Deepth, “Design of air conditioning system for residential/office building,” 2017.

W. T. Grondzik, *Air-conditioning system design manual*. Elsevier, 2007.

J. Watt, *Evaporative air conditioning handbook*. Springer Science & Business Media, 2012.

A. R. Chandra and R. C. Arora, *Refrigeration and air conditioning*. PHI Learning Pvt. Ltd., 2012.

### المحتويات

| رقم المحاضرة: الثالثة                                                                                                                                        | عنوان المحاضرة:                    |
|--------------------------------------------------------------------------------------------------------------------------------------------------------------|------------------------------------|
| <b><i>Air duct design</i></b>                                                                                                                                | اسم المدرس:                        |
| محمود حسين خليل                                                                                                                                              | الفئة المستهدفة:                   |
| طلبة المعهد التقني /قسم تقنيات ميكانيك القدرة                                                                                                                | الهدف العام من المحاضرة :          |
| التعرف على طرائق تصميم مجاري الهواء                                                                                                                          | الأهداف السلوكية او مخرجات التعلم: |
| 1- سيكون الطالب ملما بتصميم مجاري الهواء<br>2- سيتعلم طرائق تصميم مجاري الهواء<br>3- سيتعلم طريقة تحليل و حساب فقدان الضغط وتوزيع السرعة واختيار حجم المجاري | استراتيجيات التيسير المستخدمة      |
| السبورة و الداتا شو و استخدام المخططات                                                                                                                       |                                    |

|                     |                                                                                 |
|---------------------|---------------------------------------------------------------------------------|
| المهارات المكتسبة   | تحليل و حل الأسئلة الخاصة بالموضوع و اختيار المناسب منها مع التطبيقات العملية   |
| طرق القياس المعتمدة | اختبار قبلي و مناقشات و تقييم مشاركات الطالب و اختبار بعدي و اختبار نهاية الفصل |

### الأسئلة القبليّة

- س1 / ما الغاية من استخدام مجاري الهواء؟
- س2/ ماهي الاشكال الهندسية التي شاهدها عن مجاري الهواء ؟
- س3/ ماهي اهم المشاكل التي تتوقعها في اختيار وتصميم مجاري الهواء؟
- .....

## الفصل الثالث/ تصميم مجاري الهواء

### Chapter three/ Air duct design

#### 3-1 Introduction

The energy contents of moving a stream is macroscopically speaking in the kinetic ( velocity) and potential (static) forms corresponding to the velocity and static pressure

The fan delivers the energy to air in the form of static pressure and dynamic pressure (velocity pressure ) and the total will be the summation of the two.

#### 3-2 Main Concepts:

##### ■ Bernouli equation:-

$$\frac{P}{\rho} + \frac{v^2}{2} + gZ = \text{constat} \quad , \text{ Where :-}$$

$P$ : pressure "Pa" ,  $v$ : velocity "m/sec" ,  $Z$ : height "m"

By multiplying the equation above by (  $\rho$  ) :-


$$P + \frac{\rho v^2}{2} + \rho gZ = \text{constat} \quad ,$$

Where :  $P$ : static pressure ,  $P_v = \frac{\rho v^2}{2}$  (velocity pressure)

##### ■ Continuty equation:-

$$m_1 = m_2 \Rightarrow \rho_1 \times A_1 \times v_1 = \rho_2 \times A_2 \times v_2 \quad ,$$

$m$ : mass flow rate "kg/sec"

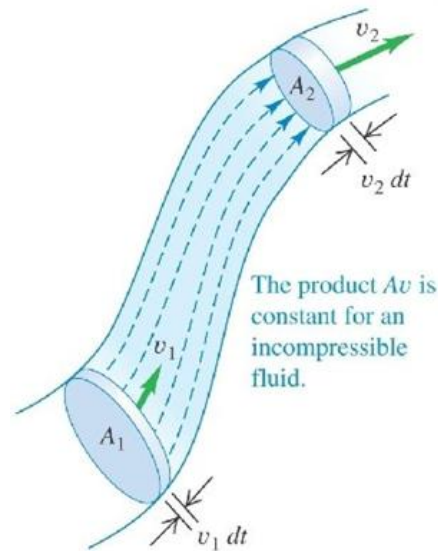

When :  $\rho_1 = \rho_2$

$$A_1 \times v_1 = A_2 \times v_2 \Rightarrow Q_1 = Q_2 ,$$

$Q$  :: volumetric flow rate "m<sup>3</sup>/sec"

### 3-3 Head and Pressure

The term head and pressure are often interchangeable however, head is the height of fluid column supported by fluid flow, while pressure is the normal force per unit area.

Head  $\Rightarrow$  pressure and pressure  $\Rightarrow$  Head

### 3-4 Fluid Resistance (pressure drop in duct)

Duct system losses are the irreversible transformation mechanical energy into heat.

There are two types of losses :- a) Friction losses b) dynamic losses

#### 3-4-1 Friction losses :-

Due to fluid viscosity and a result of momentum exchange between molecules.

Friction losses occur along the entire duct length and cause losses in static pressure.



#### 3-4-2 Dynamic losses :-

Dynamic losses result from flow distribution caused by duct mounted equipment and fittings that change the air flow path's direction and/or area (change in cross section area of duct), (losses in velocity pressure these fittings include :- entries, exits, elbow ... etc)


### 3-5 General Rules in air duct design

Many rules should be followed in duct design :-

- 1- Air should be conveyed as directly as possible to economise power , material ,space  
...
- 2- Sudden change in direction should be avoided when there are bends , turning vanes should be used to minimize the pressure loss.
- 3- Diverging section should not exceed  $20^\circ$

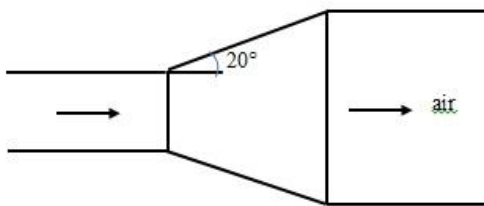

- 4- Rectangular duct should be made as nearly square as possible this will ensure minimum duct surface and cost for the same air carrying capacity  
 $W/H$  : is called Aspect ratio and it must be  $\leq 4$

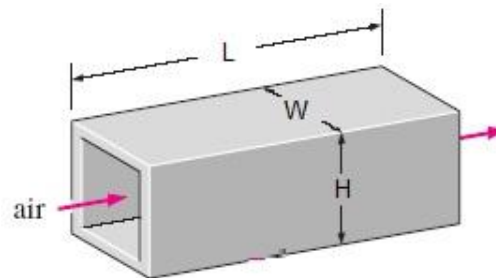


- 5- Dampers should be provided in each branch outlet for balancing system.

### 3-6 Methods of duct design

- 1- Velocity reduction method
- 2- Equal pressure drop method ( equal friction loss method)
- 3- Static regain method


Notes:- the main chart used to select the air duct capacity (dimensions) is friction-air quantity chart shown below:-

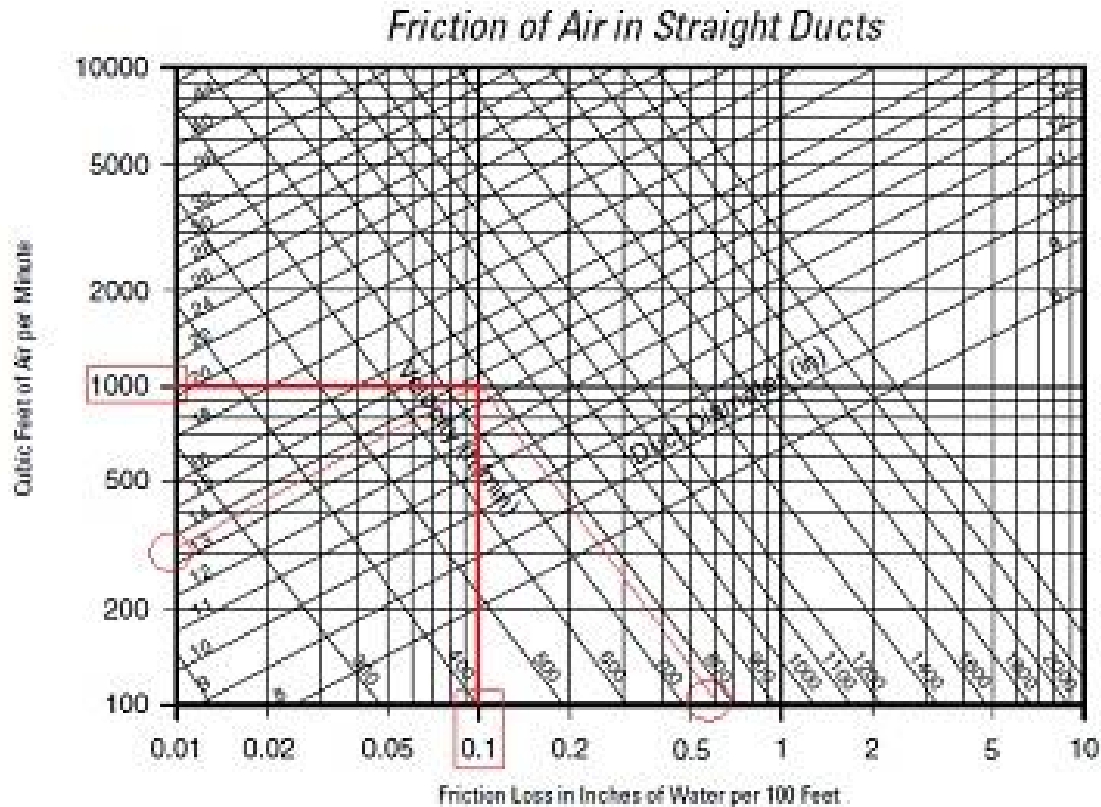

**Friction loss – air quantity chart for ducts**

### <<<<< Examples >>>>>

**Ex 3-6-1:** For the duct system as shown in figure below with dimensions and flow rates, use velocity reduction method to find the diameters and pressure drops if the air velocity after fan is (7.5m/sec).

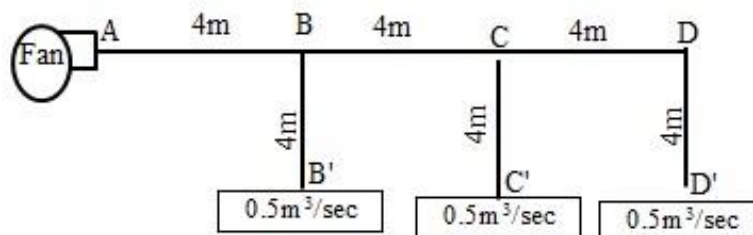


**Solution:-**

From given data with the figure information :-

- Dividing the diagram to sections (A→B , B→C , C→D' , B→B' and B→C')
- Insert to the table the value of volumetric flow rates
- Depending on the method selected (velocity reduction) by cross (Q&V) on the (friction lose – quantity chart) to calculate  $\Delta P$  & D
- On the other sections we will choosing velocity for every branch (depending on the main branch velocity and reduction method )

| Section | Q(L/sec) | Q(m <sup>3</sup> /sec) | V(m/sec) | $\Delta P$ (Pa/m) | D (m) |
|---------|----------|------------------------|----------|-------------------|-------|
| A→B     |          | 1.5                    | 7.5      |                   |       |
| B→C     |          | 1                      |          |                   |       |
| C→D'    |          | 0.5                    |          |                   |       |
| B→B'    |          | 0.5                    |          |                   |       |
| B→C'    |          | 0.5                    |          |                   |       |

**Ex3-6-2:** Solve the same wxample above by using equal pressure drop method at constant with constant pressure drop (1Pa/m).

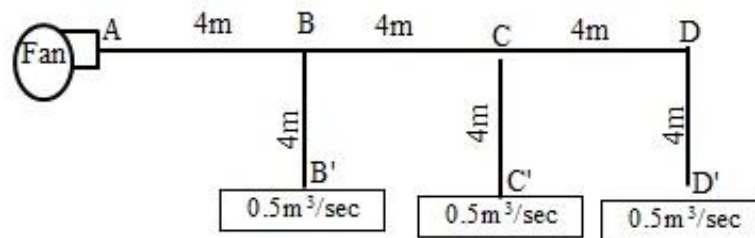

**Solution:-**

From given data with the figure information :-

- Dividing the diagram to sections (A→B , B→C , C→D' , B→B' and B→C')
- Insert to the table the value of volumetric flow rates
- Depending on the method selected (equal pressre method) by cross (Q&V) on the (friction lose – quantity chart) to calculate  $\Delta P$  & D and consider this  $\Delta P$  value for all branch
- On the other sections we will cross the value of ( $\Delta P$  & Q) to calculate (V&D)

| section | Q(L/sec) | Q(m <sup>3</sup> /sec) | $\Delta P$ (Pa/m) | V(m/sec) | D (m) |
|---------|----------|------------------------|-------------------|----------|-------|
| A→B     | 1500     | 1.5                    | 1                 | 6.8      | 520   |
| B→C     | 1000     | 1                      | 1                 | 6.4      | 450   |
| C→D'    | 500      | 0.5                    | 1                 | 5.4      | 345   |
| B→B'    | 500      | 0.5                    | 1                 | 5.4      | 345   |
| B→C'    | 500      | 0.5                    | 1                 | 5.4      | 345   |


### 3-7 Index run :-

The index run of any duct is the run having the biggest over all energy loss is termed indexrun.

It is not always possible to leap the conclusion that the run of ducting greatest length is that with the largest loss of energy and is hense the index run.


### 3-8 Air flow around bends( pressure drop in bends):-

Equivelent length of elbow:-

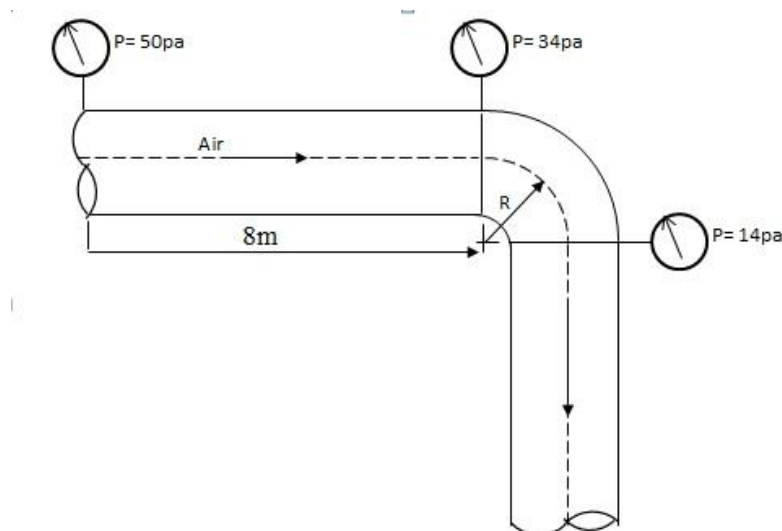

There are two method of minimizing the energy loss around the bends :-


#### 1) Using siplitters

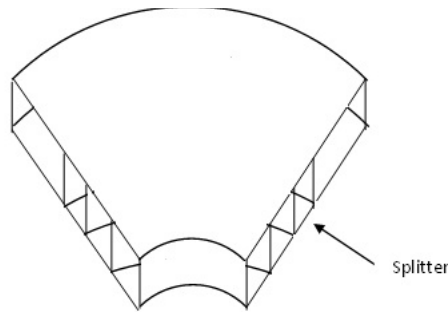

## 2) using turning vanes


### INEFFICIENT

BRANCH LOSS COEFFICIENT - APPX. 1.20  
(HEIGHT/WIDTH = 1.0)



LACK OF TURNING VANES CAUSES  
EXCESSIVE TURBULENCE IN FITTING;  
RESULTS IN VERY HIGH PRESSURE DROP

### WRONG

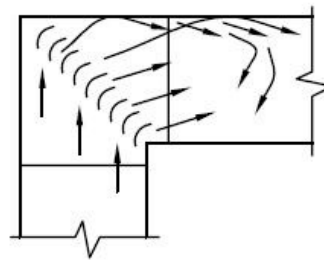


INCORRECT VANE ALIGNMENT  
CAUSES TURBULENCE; RESULTS IN  
HIGHER PRESSURE DROP

### EFFICIENT

BRANCH LOSS COEFFICIENT - APPX. 0.15  
(HEIGHT/WIDTH = 1.0)


SINGLE THICKNESS  
VANES



TURNING VANES ENSURE  
UNIFORMITY OF AIRFLOW, GREATLY  
REDUCING TURBULENCE; RESULTS  
IN VERY LOW PRESSURE DROP

### EFFICIENT


BRANCH LOSS COEFFICIENT - APPX. 0.21  
(R/W=1.0, HEIGHT/WIDTH = 1.0)



R/W = 1.0 (MINIMUM)  
R/W = 1.5 (RECOMMENDED)

SMOOTH RADIUS ENSURES UNIFORMITY OF  
AIRFLOW, GREATLY REDUCING TURBULENCE;  
RESULTS IN VERY LOW PRESSURE DROP

**Ex3-7-1 :-** Design the air duct system as shown in figure below , with dimensions and flow rates by using equal pressure drop method at constant pressure drop (0.5Pa/m) and then find total equivalent length for main duct(index run).

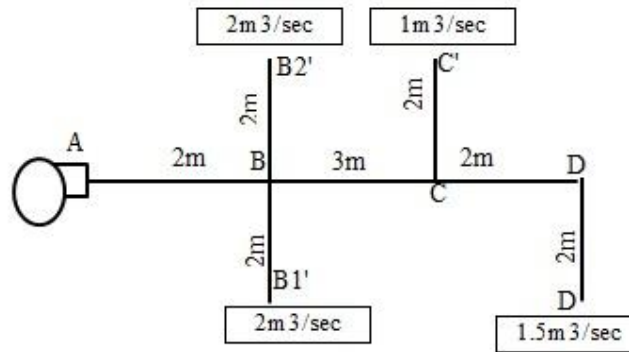

### Solution:-

| Section | Q(L/sec) | Q(m³/sec) | $\Delta P$ (Pa/m) | V(m/sec) | D (m) |
|---------|----------|-----------|-------------------|----------|-------|
| A→B     |          | 6.5       | 0.5               |          |       |
| B→C     |          | 2.5       | 0.5               |          |       |
| C→D'    |          | 1.5       | 0.5               |          |       |
| B→B1    |          | 2         | 0.5               |          |       |
| B→B2    |          | 2         | 0.5               |          |       |
| C→C'    |          | 1         | 0.5               |          |       |

The Index run is A→D'


Total equivalent length of index run = length(A→B)+ length(B→C)+ length (C→D) +length (D→D')+length(elbow C→D')

length(elbow C→D')→  $L/D=g \rightarrow L=D \times g = 590 \times 9.81 = 5310 \text{ mm} / 1000 = 5.31 \text{ m}$

length(elbow C→D')=5.31m

Total equivalent length of index run = 2+3+2+2+5.31=14.31m

**Ex3-7-2:-** In aduct system as shown below with dimensions and air flow rates use balanced pressure lose method to find the diameters of main duct and branches , if the static pressure at ((A)) point equal to 21Pa ,and calculate dynamic pressure (velocity pressure)  $P_v$  for all sections.

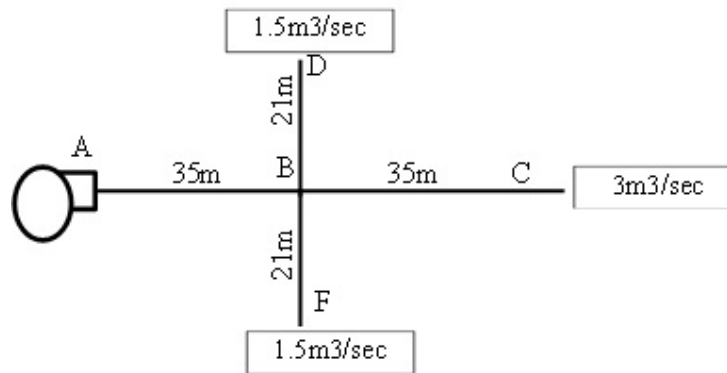

### Solution:-

Main duct length = 35+35=70m

$P_s$  at A = 21Pa and for calculating friction losses per meter length ( $\Delta P$ ) :

$$\Delta P_s = \frac{P_{s \text{ at A}}}{L} = \frac{21}{70} = 0.3 \text{ Pa/m}$$

Air flow rate (air quantity )at A=3+1.5+1.5 = 6m³/sec

By usinf friction loss-air quantity chart :

| Section | Q(L/sec) | Q(m³/sec) | $\Delta P$ (Pa/m) | V(m/sec) | D (m) |
|---------|----------|-----------|-------------------|----------|-------|
| A→B     | 6000     | 6.0       | 0.3               |          |       |
| B→C     | 3000     | 3.0       | 0.3               |          |       |

For branches : B→D and B→F

$P_s$  at B=( $P_{s \text{ at A}}$ )-(35×0.3) =21-10.5 =10.5 Pa

$$\Delta P_s = \frac{P_{s \text{ at B}}}{L} = \frac{10.5}{21} = 0.5 \text{ Pa/m} \text{ for both B→D and B→F branches}$$

By usinf friction loss-air quantity chart :


| Section | Q(L/sec) | Q(m³/sec) | $\Delta P$ (Pa/m) | V(m/sec) | D (m) |
|---------|----------|-----------|-------------------|----------|-------|
| B→D     | 1500     | 1.5       | 0.5               |          |       |
| B→F     | 1500     | 1.5       | 0.5               |          |       |

For calculating dynamic pressure (velocity pressure)  $P_v$  for all sections , by using :

$$P_v = \frac{1}{2} \times \rho \times v^2 \quad \text{with taking in corresponding } \rho = 1.2 \text{ Kg/m}^3$$


| Section                | $P_v = \frac{1}{2} \times \rho \times v^2$ |
|------------------------|--------------------------------------------|
| $P_v(A \rightarrow B)$ | $Pv_{AB} =$                                |
| $P_v(B \rightarrow C)$ | $Pv_{BC} =$                                |
| $P_v(B \rightarrow F)$ | $Pv_{BF} =$                                |
| $P_v(B \rightarrow E)$ | $Pv_{BE} =$                                |

**3-9 Circular equivalents of rectangular ducts:** the head loss due to friction is greater for a rectangular duct than for a circular duct for the same cross-sectional area and capacity, therefore we must find the rectangular cross sectional area dimensions equivalent to the circular cross section area dimensions for the duct with equal friction loss and capacity.

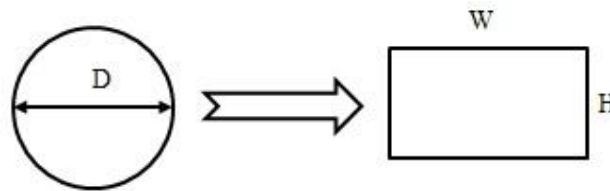

$$D = 1.3 \frac{[H \times W]^{0.625}}{[H + W]^{0.25}}$$

**Ex3-9-1:-** duct system as shown below with diameters and air flow rates use equal pressure method to find the diameters and equivalent rectangular ducts then find the static pressure after fan. if the velocity after fan position is 8m/sec.

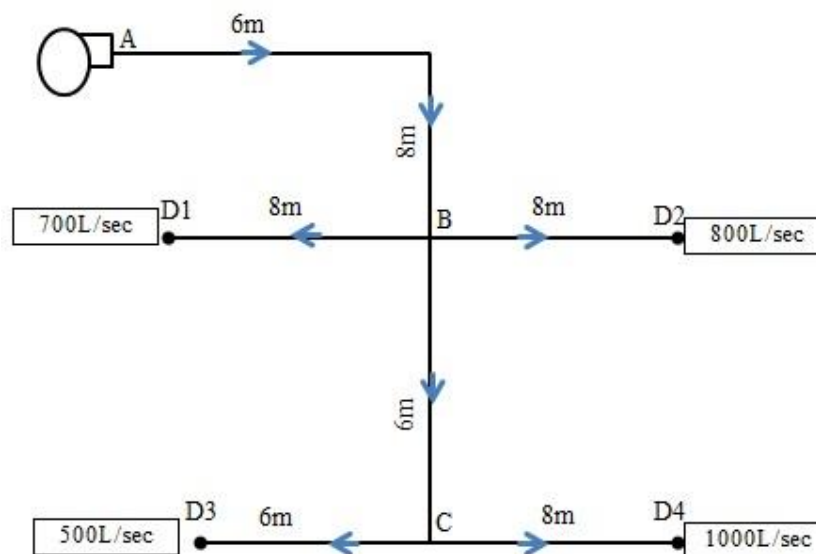

### Solution:

| Section | Q(L/sec) | V(m/sec) | $\Delta P(\text{Pa/m})$ | D (m)<br>circular | W×H<br>rectangular |
|---------|----------|----------|-------------------------|-------------------|--------------------|
| A→B     | 3000     | 8        |                         |                   |                    |
| B→C     | 1500     |          |                         |                   |                    |
| B→D1    | 700      |          |                         |                   |                    |
| B→D2    | 800      |          |                         |                   |                    |
| C→D3    | 500      |          |                         |                   |                    |
| C→D4    | 1000     |          |                         |                   |                    |


( نتبع الخطوات التالية :- *Stativ pressure after the fan* لايجاد الضغط الاستاتيكي بعد المروحة )

- معرفة طول المسار في المجرى (اي المسار الذي يكون فيه اكبر خسائر للضغط) وهو مايسمى بالمجرى الدليلي (Index run) ومن خلال ملاحظة مخطط منظومة مجاري الهواء فان اطول مسار هو من نقطة (A) الى نقطة (D4)

$$\text{length of index run}(A \rightarrow D4) = [L(A-B) + L(\text{elbow } A-B)] + [L(B-C) + L(C-D4) + L(\text{elbow } C-D4)]$$

بعدها يجب ايجاد طول الحنيتين في المعادلة اعلاه

الحنية (elbow A-B) :

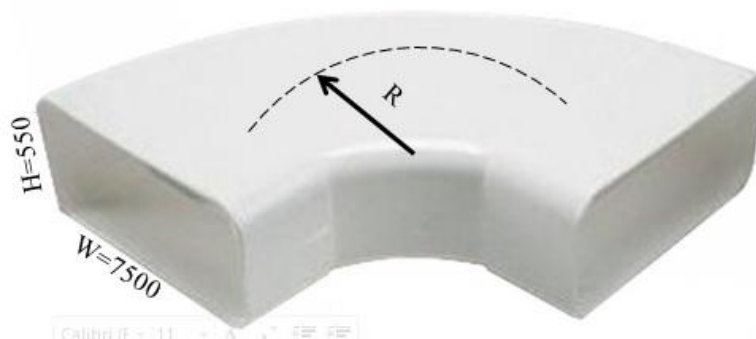

- يتم حساب نسبة (H/W)  $\frac{H}{W} = \frac{550}{7500} = 0.073$
- يتم حساب نسبة (R/W) واذا لم تعطى معلومات كافية لحسابها فتؤخذ افضل نسبة (R/W=1.5)
- باستخدام جدول طول الحنيات الموضح ادناه :
- تستخرج النسبة (L/W) من الجدول ومنها نجد قيمة L التي تمثل طول الحنية

$$L/W = 4.46 \rightarrow L/7500 = 4.46 \rightarrow L = 33450 \text{ mm} = 33450/1000 = 33.45 \text{ m}$$

(elbow C-D4) : وهكذا بنفس الطريقة يتم حساب طول الحنية الحنية

$$H/W = 350/500 = 0.7 \rightarrow R/W = 1.5 \rightarrow L/W = 4.4 \rightarrow L/500 = 4.4 \rightarrow L = 2200 \text{ mm} = 2.2 \text{ m}$$

*Index run* والآن تعوض اطوال الحنيات و اطوال المقاطع في معادلة المجرى الدائلي )


$$\text{length of index run}(A \rightarrow D) = [L(A-B) + L(\text{elbow } A-B)] + [L(B-C) + L(C-D) + L(\text{elbow } C-D)]$$

$$\text{length of index run}(A \rightarrow D) = [6 + 3.34 + 8] + [6 + 2.2 + 8] = 33.545 \text{ m}$$

$$P_s \text{ at } (A) = L(\text{index run}) \times \Delta P = 33.545 \times 0.9 = 30.2 \text{ Pa}$$


### Sheet NO 3 (Air duct design problems)

Q1:- for duct system as shown in fig. with dimensional flow rate , Use velocity reduction method to find the diameters and pressure drops , if the air velocity after the fan equal 7.5 m/s .

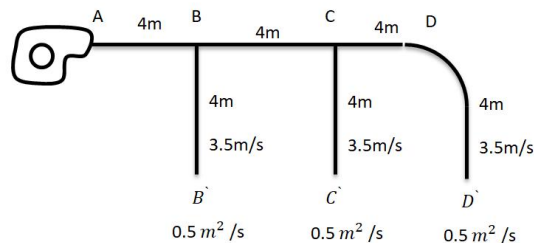


**Q2:-** Solve the same example at first method but use equal pressure drop method at constant pressure drop (1Pa/m)


Ex3:- Design the air duct system as shown in fig. with dimensions and flow rates by using equal pressure drop method at constant pressure drop (0.5Pa/m) and find total equivalent length for main duct (index run).

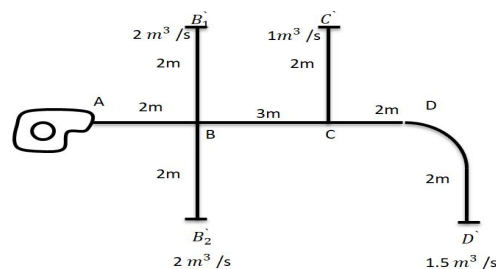


Q4:- In a duct system as shown below the dimensions and air flow rate , using balanced pressure method to find the diameter of the main duct and branches also find the velocity at each section . if the static pressure at A equal (21Pa) ?

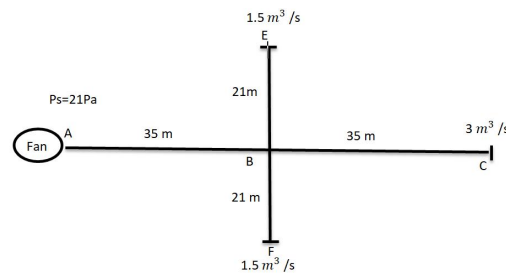

Q5:- Design the air duct system as shown in fig. by using equal pressure method at constant pressure drop ( $0.5 \text{ Pa/m}$ ) .

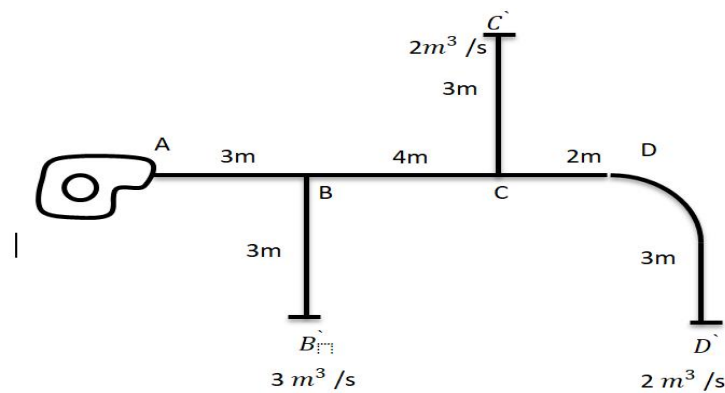

Q6:- Design the air duct system as shown in fig. by using equal pressure method at constant pressure drop ( $0.6 \text{ Pa/m}$ ) .

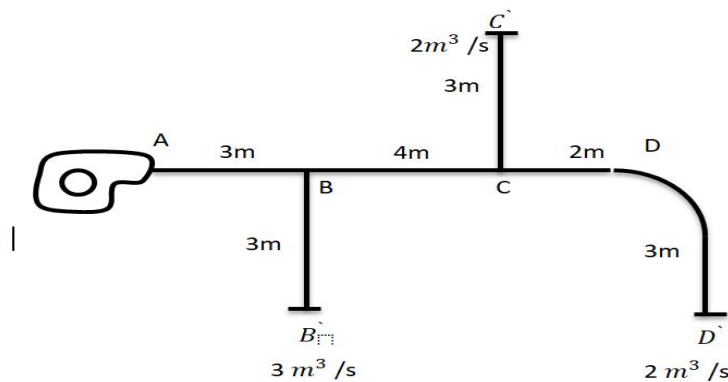

References:

- W. P. Jones, *Air conditioning application and design*. Routledge, 2012.  
 B. J. Burley and others, "An update on ANSI/ASHRAE standard 62.1," *Ashrae J.*, vol. 64, no. 9, pp. 28–30, 2022.

V. V. P. Bharathi, A. Kodliwad, B. A. Kumar, and V. V. N. Deepth, “Design of air conditioning system for residential/office building,” 2017.

W. T. Grondzik, *Air-conditioning system design manual*. Elsevier, 2007.

J. Watt, *Evaporative air conditioning handbook*. Springer Science & Business Media, 2012.

A. R. Chandra and R. C. Arora, *Refrigeration and air conditioning*. PHI Learning Pvt. Ltd., 2012.

## المحتويات

| رقم المحاضرة: الرابعة              | عنوان المحاضرة:                                                                                                                                                                                  |
|------------------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| اسم المدرس:                        | <b>Pimped and pipe system</b>                                                                                                                                                                    |
| الفئة المستهدفة:                   | محمود حسين خليل                                                                                                                                                                                  |
| الهدف العام من المحاضرة:           | طلبة المعهد التقني /قسم تقنيات ميكانيك القدرة                                                                                                                                                    |
| الأهداف السلوكية او مخرجات التعلم: | التعرف على أنواع المضخات و ربطها و تصميم و تحليل الضغوط في شبكات الانابيب                                                                                                                        |
| استراتيجيات التيسير المستخدمة      | 1-سيكون الطالب ملما بأنواع المضخات و طرائق ربطها<br>2- سيتعلم تصميم شبكة انابيب وتحليل خسائر الضغط فيها<br>3- سيتعلم استخدام الوصلات المناسبة وحسب التطبيق وطبيعة الخسائر المصمم لها هذا التطبيق |
| المهارات المكتسبة                  | السرورة و الداتاشو و استخدام المخططات                                                                                                                                                            |
| طرق القياس المعتمدة                | تحليل و حل الأسئلة الخاصة بالموضوع و اختيار المناسب منها مع التطبيقات العملية                                                                                                                    |
|                                    | اختبار قبلي و مناقشات وتقييم مشاركات الطالب و اختبار بعدي و اختبار نهاية الفصل                                                                                                                   |

## الأسئلة القبلية

س1 / ما هي أنواع المضخات التي رايتها سابقا؟

س2/ ماهي أنواع الضغوط في تطبيقات ضخ السوائل ؟

س3/ ماهي اهم المشاكل التي تتوقعها في اختيار وتصميم شبكات الانابيب و اختيار المضخات المناسبة لها ؟

\*\*\*\*\*

## Pumped and pipe system

### الانابيب و المضخات

#### 4-1 Introduction:-

**Pipe system:** - is connecting air-conditioning units with water sources (chillers or boiler ..... )by pump.

Types of pipe system:-

1. Open system ..... figure 4-1-a
2. Closed system .....figure4- 1-b

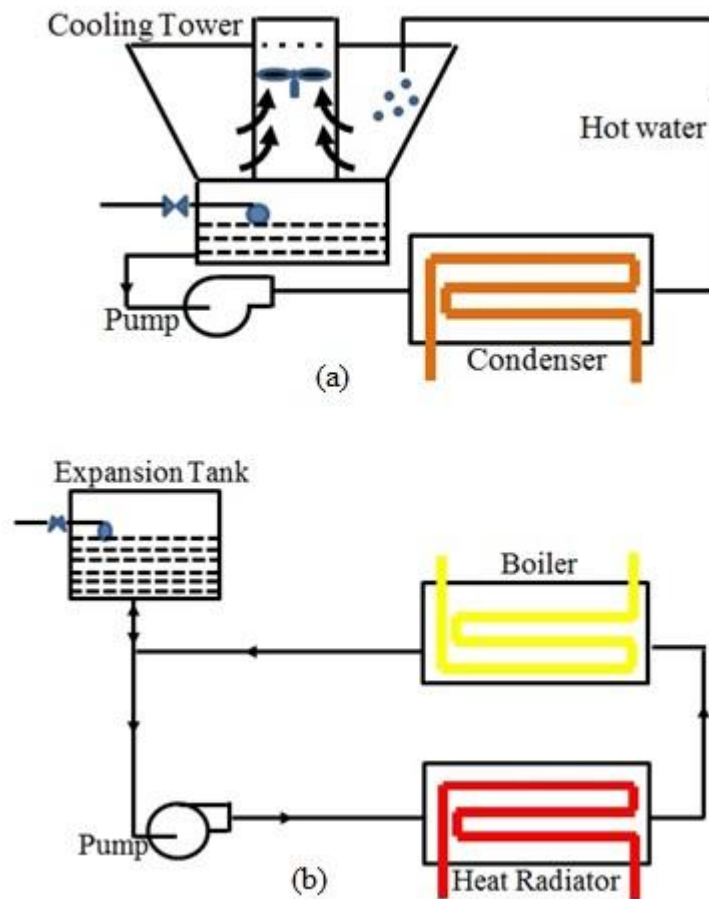


Figure 4-1 (a)Open type piping system, (b) closed type piping system

#### **4-2 Classification of closed pipe systems:-**

##### **4-2-1 / According to the number of pipes used in the system:-**

1. One pipe system.
2. Two pipe system.
3. Three pipe system.
4. Four pipe system.

#### 4-2-2/ According to the return pipes:-

1. Direct return.
2. Reverse return. Figure 4-2

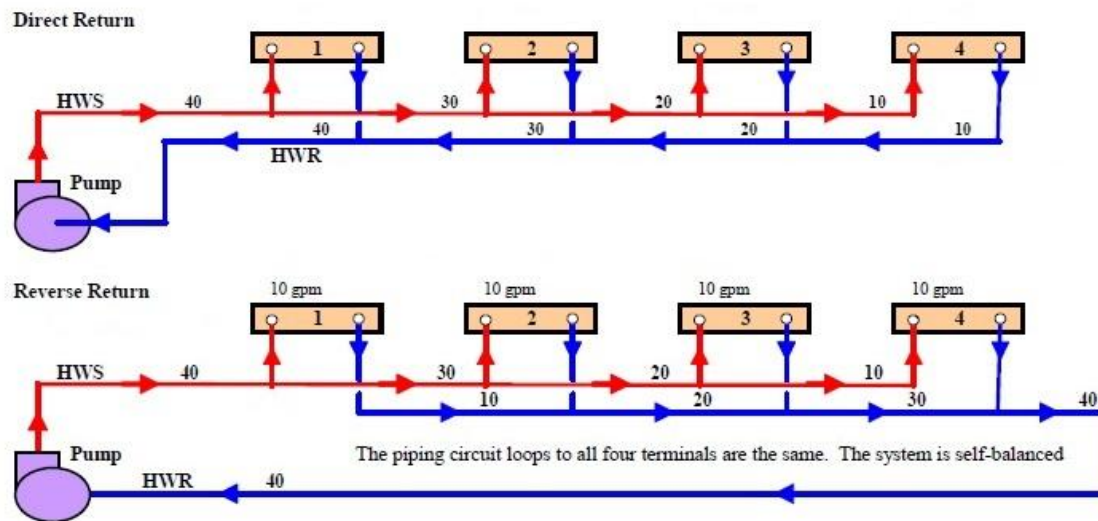


Figure 4-2 direct and reverse return in piping system

Direct return used with units need different water flow rates, reverse return used with units need same water flow rates. The reverse return closed pipe system is self balanced because the length of water cycle (supply and return) for all units is equal.

#### 4-3 / Elements of pipe system:-

1. pipes :- from galvanized steel or black steel.
2. Elbow :- change the direction of fluid
3. Tee:- use with branches
4. Reducer :- decrease the diameter of pipe .
5. Union: - connect two pipes together.

6. Gate valve: - used for on l off it used with each A/ C unit.
7. Globe valves: - to control the water flow rate.
8. Check valve: - used to prevent the flow of water in opposite direction / pumps.
9. Strainer: - connected with supply pipe for each A/C unit.
10. Expansion joint:-used with long pipes and pumps.
11. Expansion tank:-
  - a- keeps the system pressure when working temperature change.
  - b- The way to refill the system with water.

#### 4-4/ Pumps types:-

1. Centrifugal pumps.
2. Radial flow pumps.
3. Axial flow pumps.
4. Scroll case pumps.

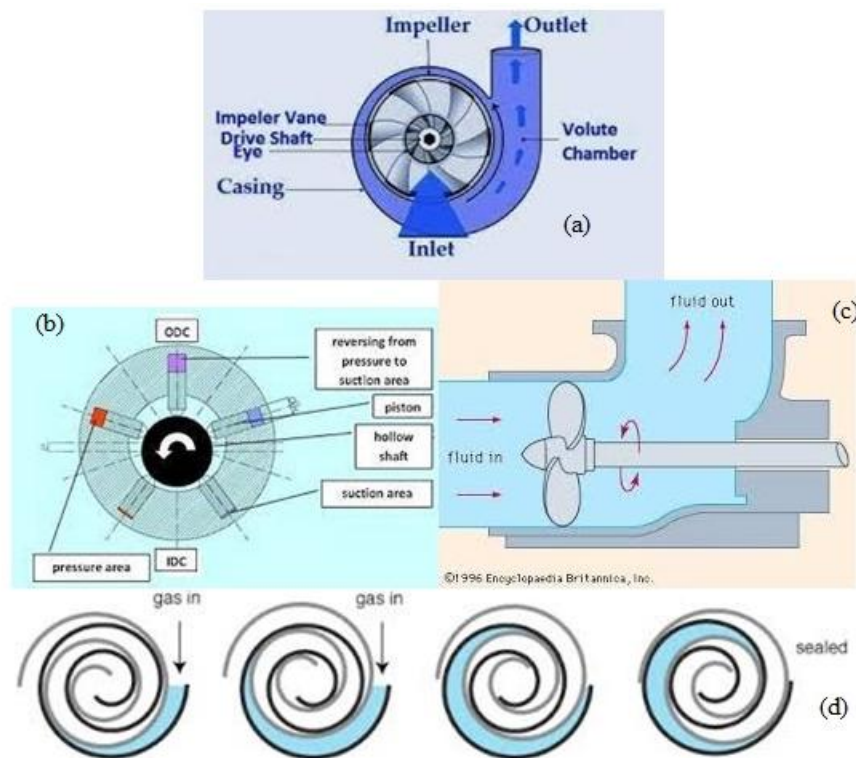


Figure 4-3 (a- centrifugal fan , b- radial fan , c- axial fan ,d-scroll fan)

## 4-5/Pumps connection :-

### 4-5-1 /Parallel connection :-

$$Q_{total} = Q_1 + Q_2 + Q_3 + \dots$$

$$P_{total} = P_1 = P_2 = P_3 = \dots$$

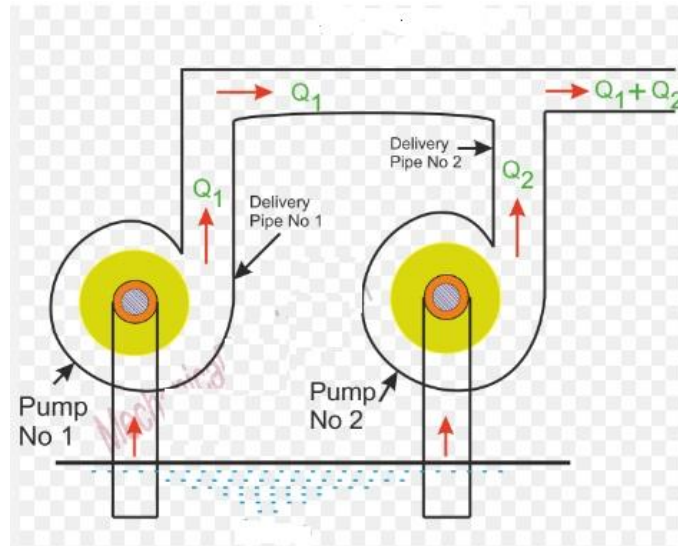


Figure 4-4 pumps in parallel connection

### 4-5-2/ Series connection:-

$$P_{total} = P_1 + P_2 + P + \dots$$

$$Q_{total} = Q_1 = Q_2 = Q_3 = \dots$$

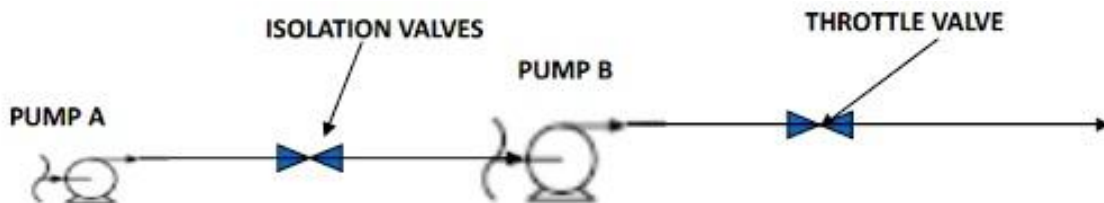


Figure 4-5 pumps in series connection

## 4-6/ Pumps Law

$$P_t = \left( P_d + \frac{1}{2} \rho V_d^2 \right) - \left( P_s - \frac{1}{2} \rho V_s^2 \right)$$

Where:-

$P_d$ :-static pressure at discharge line.


$P_s$ :- static pressure at suction line .

$V_d^2$ :- water velocity at discharge line.

$V_s^2$ :- water velocity at suction line.

## 4-7/ Pressure calculation in the system :-


### 4-7-1/Closed system:-

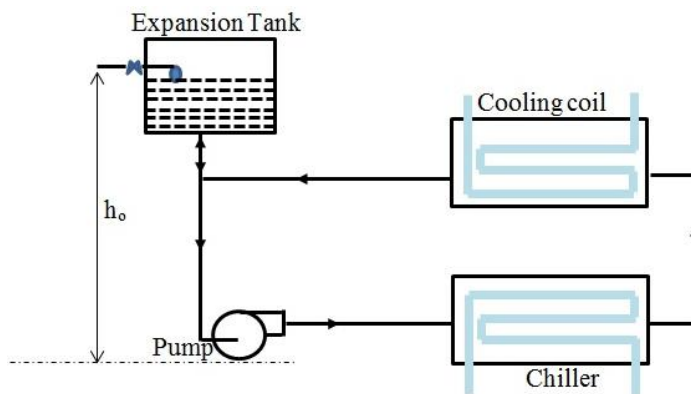

$h_o$  :- head pressure in the system (minimum pressure). Or static pressure ( $p_o$ )

$$p_o = \rho \cdot g \cdot h_o = P_s$$

### 4-7-2/Open system :-

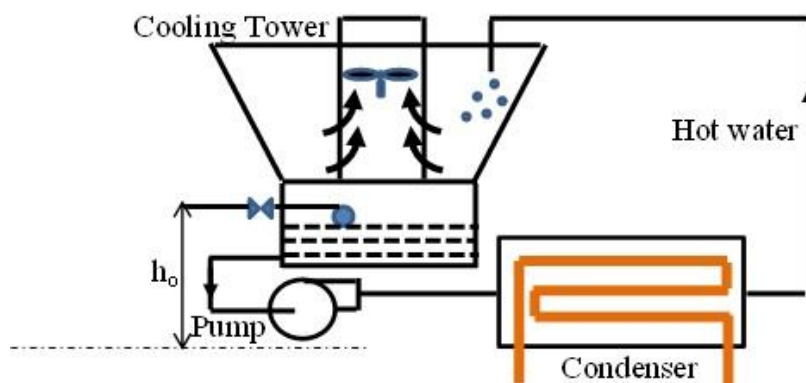

$h_o$  :- head pressure in the system (minimum pressure). Or static pressure ( $p_o$ )

$$h_o = \rho \cdot g \cdot h_o = P_s$$

#### 4-8/ Pump power:- ( $W_p$ )

A mount os energy supplied to the water .

$$W_p = Q \cdot P_t$$

Where:

Q:- volumetric rate of water ( $m^3/s$ )

$P_t$  :- total pressure (Pa)


#### 4-9/ Pump efficiency ( $\zeta$ )

The rate of energy supply to the water divided by the rate of energy consumed in the pump's impellers

$$\zeta = \frac{W_p}{W_s}$$

$W_s$  :- power consumed by pumps impeller

Ex4-1:- the pressure gauge reading in the inlet of cooling coil is ( 100Kpa) the reading of another pressure gauge in the exit (50 Kpa) the second gauge is (1m) above than the first gauge . Calculate the pressure drop in the cooling coil ? the coil run by chilled water .

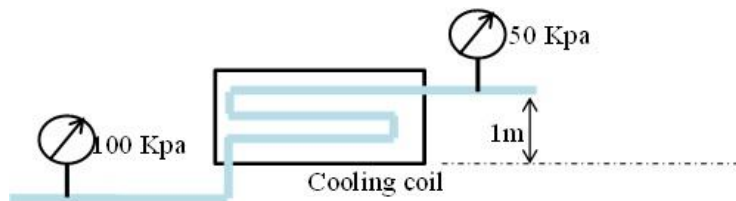

#### Solution :-

Pressure due to 1m of water is:-

$$P = \rho \times g \times h = 1000 \times 9.81 \times 1 = 9810pa \leftrightarrow P = 1.89kpa$$

Total Pressure at inlet pipe = 50 + 9.81 = 59.81 kpa

Pressure drop = 100 - 59.81 = 40.19kpa.

For calculation pressure drop for pipes we use the chart of pressure drop (friction) shown below:

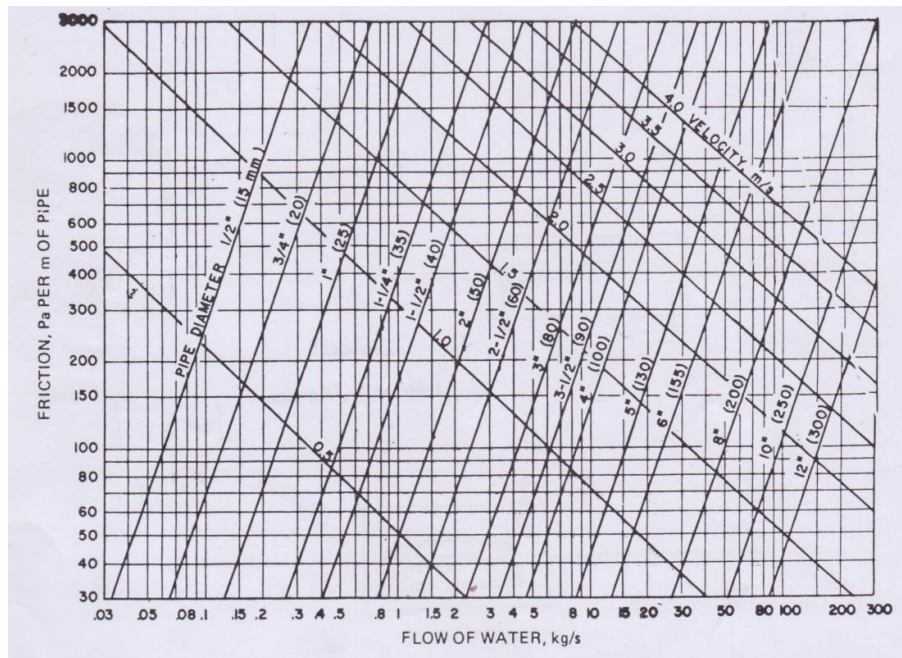


Figure 4-6 friction loss – flow rates piping losses chart

For calculating equivalent length for bends and fittings, we must use the table below:

Table 4-1 the equivalent length for bends and fitting piping system

| حجم الأنبوب عقدة (ملمتر) |        |                      |                      |        |        | التركيب            |
|--------------------------|--------|----------------------|----------------------|--------|--------|--------------------|
| $\frac{3}{4}$ (20)       | 1 (25) | $1 \frac{1}{4}$ (35) | $1 \frac{1}{2}$ (40) | 2 (50) | 3 (80) |                    |
| 1-6                      | 2-1    | 2-6                  | 3-1                  | 4-2    | 6-5    | عكس                |
| 1-1                      | 1-5    | 1-8                  | 2-2                  | 2-9    | 4-5    | 90°                |
| 0-8                      | 1-0    | 1-3                  | 1-6                  | 2-1    | 3-0    | 45°                |
|                          |        |                      |                      |        |        | طويل               |
| 2-8                      | 3-8    | 4-7                  | 5-6                  | 7-5    | 13     | تقسيم              |
| 6-3                      | 8-3    | 10-4                 | 12-5                 | 16-7   | 25     | 100° / تحويل جانبي |
| 14-3                     | 18-7   | 23-4                 | 28-1                 | 37-5   | 56     | 50° / تحويل جانبي  |
| 25                       | 33-3   | 41-6                 | 49-8                 | 66-7   | 100    | 33° / تحويل جانبي  |
|                          |        |                      |                      |        |        | 25° / تحويل جانبي  |
|                          |        |                      |                      |        |        | صمامات             |
| 18-7                     | 25-0   | 33-8                 | 36-8                 | 50-0   | 66     | كروي (مفتوح)       |
| 0-8                      | 1-0    | 1-3                  | 1-6                  | 2-1    | 3-0    | بوابة (مفتوح)      |
| 1-6                      | 2-1    | 2-6                  | 3-1                  | 4-2    | 6-5    | سداد (مفتوح)       |
| 3-6                      | 4-2    | 5-2                  | 6-2                  | 8-3    | 12-5   | زاوي (مفتوح)       |
| 0-6                      | 0-8    | 1-0                  | 1-3                  | 1-7    | 2-5    | مضفر               |
| 4-7                      | 6-3    | 7-8                  | 9-4                  | 12-5   | 19     | أو وحدة تدفئة      |

After calculating the friction loss of the pipe, it should be known that this value is not quite correct, and a correction coefficient should be used to correct it.

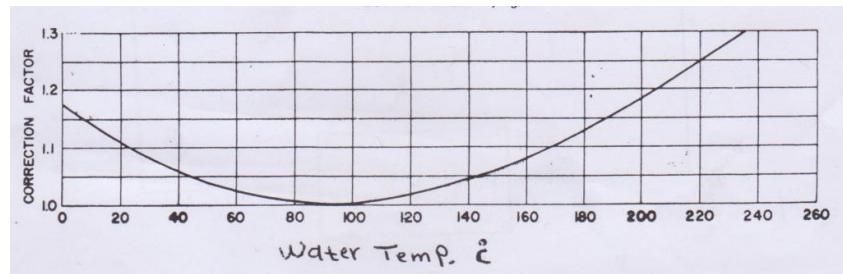


Figure 4-7 correction factor with water temperature chart

Ex4-2:- find the equivalent length for a pipe ( $d=50\text{mm}$ ) and its length (40m) , consist of :- 1 globe valve , two long elbow  $90^\circ$  , 1 tee with 50% by pass ?

### Solution:-

From table 4-1 :

1 global valve  $= 1 \times 50 = 50\text{feet}$

2 elbow ( $90^\circ$ ) long  $= 2 \times 2.1 = 4.2\text{ feet}$

1 Tee 50%  $= 1 \times 16.7 = 16.7\text{ feet}$

Equivlent length for fitting  $= 50 + 4.2 + 16.7 = 70.9\text{ feet} / 3.28 = 21.6\text{m}$

Total length for pipe and fitting  $= 40 + 21.6 = 61.6\text{m}$

Ex4-3 /If the system in previous example transmits chilled water with ( $3.5\text{kg/s}$ ) and its temperature ( $8^\circ\text{C}$ ) find the pressure drop in system.

Solution:


From chart at  $Q=3.5\text{kg/d}$  and  $d=50\text{mm}$  we specified pressure drop ( $\Delta P=550\text{pa/m}$ ) , the correction factor at ( $T=8^\circ\text{C}$ ) is equal to (1.15) :

$$\Delta P_c = \Delta P \times \text{correction factor} = 550 \times 1.15 = 632.5\text{pa/m}$$

$$\text{Total pressure drop in system } (\Delta P_t) = \Delta P_c \times \text{total length} = 632.5 \times 61.6 = 38.931\text{Kpa}$$

Ex4-4 :- in a closed pipe system the total pressure drop (50 Kpa) , the expansion tank located at (40m) high a bove the suction line of the pump . find the water head and pressure which the pressure gauge read it as follow :-

1. Down the suction line by (0.5m).
2. A bove the discharge line of the pump by ( 1.5m).

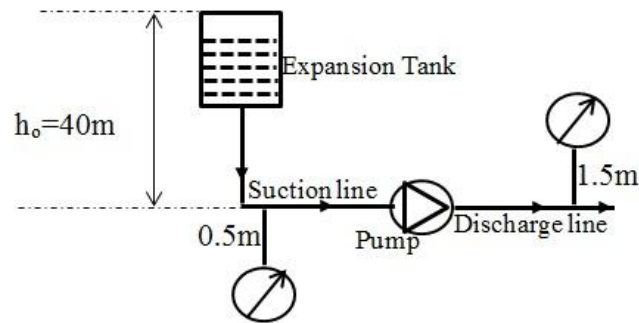

### Solution:-

$$h_o = 40m \rightarrow P_o = P_s$$

$$P_s = \rho \times g \times h_o = 1000 \times 9.81 \times 40 = 392400Pa = 392.4Kpa$$

$$\text{Pressure due to } (0.5mH_2O) = \rho \times g \times h_o = 1000 \times 9.81 \times 0.5 = 4905Pa = 4.905kpa$$

$$1) \text{ Pressure gage reading} = 392.4 + 4.905 = 397.305 \text{ kpa ,}$$

$$\text{Water head} = 40 + 0.5 = 40.5mH_2O$$



$$2) \Delta P = P_d - P_s \Rightarrow 50 = P_d - 392.4 \Rightarrow P_d = 442.4kpa$$

$$\begin{aligned} \text{Pressure due to } (1.5mH_2O) &= \rho \times g \times h_o = 1000 \times 9.81 \times 1.5 = 14715pa \\ &= 14.715kpa \end{aligned}$$

$$\text{Pressure gage reading} = 442.4 - 14.715 = 427.685 \text{ kpa} \approx 427.7kpa$$


$$\begin{aligned} \text{Water head} \Rightarrow P &= \rho \times g \times h \Rightarrow 427.7 \times 1000 = 1000 \times 9.81 \times h \Rightarrow h = \\ &43.598mH_2O \end{aligned}$$

| حجم الأنبوب عقدة (ملمتر) |        |                     |                     |        |        | التركيب          |
|--------------------------|--------|---------------------|---------------------|--------|--------|------------------|
| $\frac{3}{4}$ (20)       | 1 (25) | $1\frac{1}{4}$ (35) | $1\frac{1}{2}$ (40) | 2 (50) | 3 (80) |                  |
| 1-6                      | 2-1    | 2-6                 | 3-1                 | 4-2    | 6-5    | عكس 90°          |
| 1-1                      | 1-5    | 1-8                 | 2-2                 | 2-9    | 4-5    | 45°              |
| 0-8                      | 1-0    | 1-3                 | 1-6                 | 2-1    | 3-0    | طويل 90°         |
|                          |        |                     |                     |        |        | تقسيم            |
| 2-8                      | 3-8    | 4-7                 | 5-6                 | 7-5    | 13     | 100° تحويل جانبي |
| 6-3                      | 8-3    | 10-4                | 12-5                | 16-7   | 25     | 50° تحويل جانبي  |
| 14-3                     | 18-7   | 23-4                | 28-1                | 37-5   | 56     | 33° تحويل جانبي  |
| 25                       | 33-3   | 41-6                | 49-8                | 66-7   | 100    | 25° تحويل جانبي  |
|                          |        |                     |                     |        |        | صمامات           |
| 18-7                     | 25-0   | 33-8                | 36-8                | 50-0   | 66     | كروي (مفتوح)     |
| 0-8                      | 1-0    | 1-3                 | 1-6                 | 2-1    | 3-0    | بوابي (مفتوح)    |
| 1-6                      | 2-1    | 2-6                 | 3-1                 | 4-2    | 6-5    | سداد (مفتوح)     |
| 3-6                      | 4-2    | 5-2                 | 6-2                 | 8-3    | 12-5   | زاوي (مفتوح)     |
| 0-6                      | 0-8    | 1-0                 | 1-3                 | 1-7    | 2-5    | مضفر             |
| 4-7                      | 6-3    | 7-8                 | 9-4                 | 12-5   | 19     | أو وحدة تدفئة    |

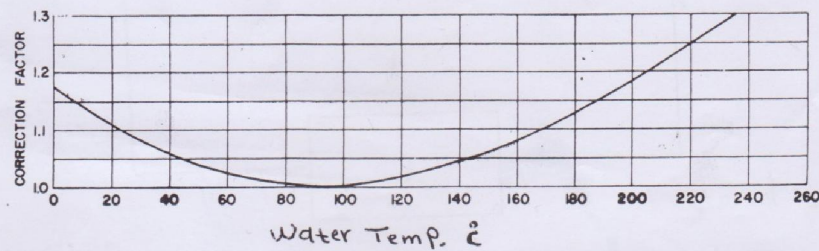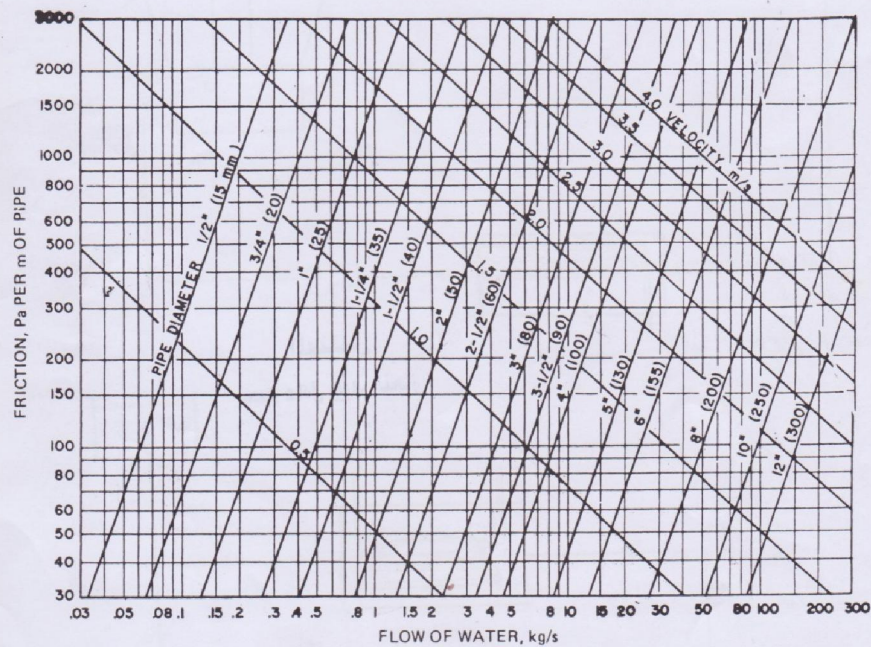

## Sheet NO 4

Q1:- the pressure gauge reading in the inlet of cooling coil is ( 100Kpa) the reading of another pressure gauge in the exit (50 Kpa) the second gauge is (1m) above than the first gauge . Calculate the pressure drop in the cooling coil ? the coil run by chilled water .

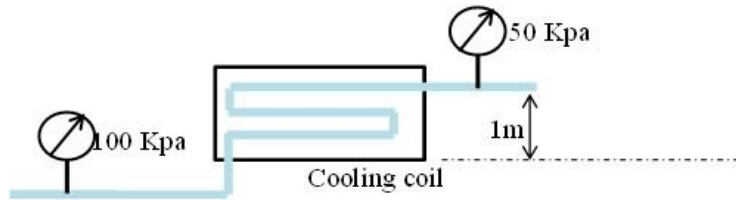

Q2:- find the equivalent length for a pipe (d=50mm) and its length (40m) , consist of :- 1 globe valve , two long elbow 90° , 1 tee with 50% by pass ?

Q3: If the system in previous example transmits chilled water with (3.5kg/s) and its temperature (8°C) find the pressure drop in system.

### References

W. P. Jones, *Air conditioning application and design*. Routledge, 2012.

B. J. Burley and others, “An update on ANSI/ASHRAE standard 62.1,” *Ashrae J.*, vol. 64, no. 9, pp. 28–30, 2022.

V. V. P. Bharathi, A. Kodliwad, B. A. Kumar, and V. V. N. Deepth, “Design of air conditioning system for residential/office building,” 2017.

W. T. Grondzik, *Air-conditioning system design manual*. Elsevier, 2007.

J. Watt, *Evaporative air conditioning handbook*. Springer Science & Business Media, 2012.

A. R. Chandra and R. C. Arora, *Refrigeration and air conditioning*. PHI Learning Pvt. Ltd., 2012.

### المحتويات

| Air conditioning systems and air filtration                | رقم المحاضرة: الخامسة<br>عنوان المحاضرة: |
|------------------------------------------------------------|------------------------------------------|
| محمود حسين خليل                                            | اسم المدرس:                              |
| طلبة المعهد التقني /قسم تقنيات ميكانيك القدرة              | الفئة المستهدفة :                        |
| التعرف على التصنيف العام لانظمة التكييف التي تستخدم الهواء | الهدف العام من المحاضرة:                 |

|                                    |                                                                                                                                                                       |
|------------------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| الأهداف السلوكية او مخرجات التعلم: | 1- سيكون الطالب ملماً بأنواع أنظمة التكييف وتصنيفاتها<br>2- سيتعلم تصميم أنظمة التكييف من ناحية توزيع الهواء<br>3- سيتعلم تصنيف أنواع الفلاتر المستخدمة لتنقية الهواء |
| استراتيجيات التيسير المستخدمة      | السبورة والداتا شو واستخدام المخططات                                                                                                                                  |
| المهارات المكتسبة                  | تحليل وحل الأسئلة الخاصة بالموضوع واختيار المناسب منها مع التطبيقات العملية                                                                                           |
| طرق القياس المعتمدة                | اختبار قبلي ومناقشات وتقييم مشاركات الطالب واختبار بعدي واختبار نهاية الفصل                                                                                           |

### الأسئلة القبلية

س1 / ما هي أنواع أنظمة التكييف في منزلك الشخصي او اقرب بناية زرتها؟

س2/ ماهي أنواع الفلاتر التي تتوقع استخدامها في أنظمة التكييف ؟

س3/ ماهي اهم المشاكل التي تتوقعها في اختيار وتصميم الفلاتر و كيفية صيانتها ؟

\*\*\*\*\*

## Chapter five

### Air conditioning systems and air filtration

#### 5-1 Airconditioning systems/ The decision to selection the A/C system:-

- 1- The satisfaction of occupants.
- 2- Fillness of the system for space.
- 3- The economic consideration.

#### 5-2Types of Heating, ventilating and Air-conditioning (H.V.A.C) system:-

##### 5-2-1 All –air system.

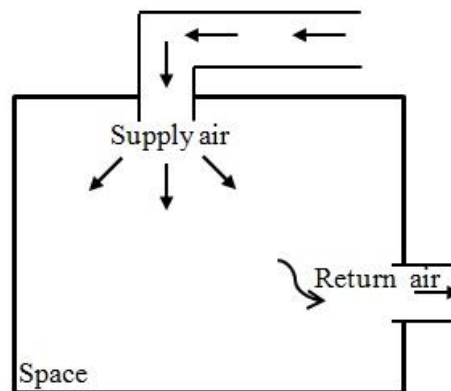


Figure 5-1 all air system

##### 5-2-2 All – water system

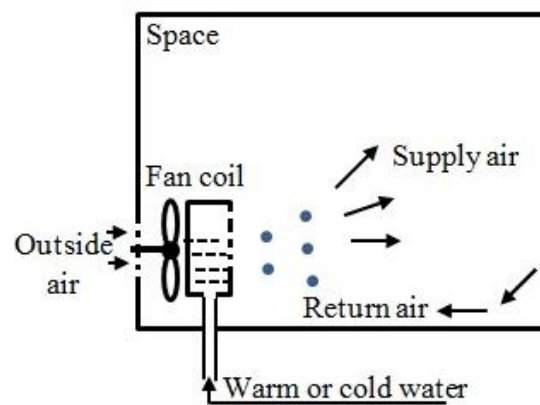


Figure 5-2 all water system

##### 5-2-3 Air –water system

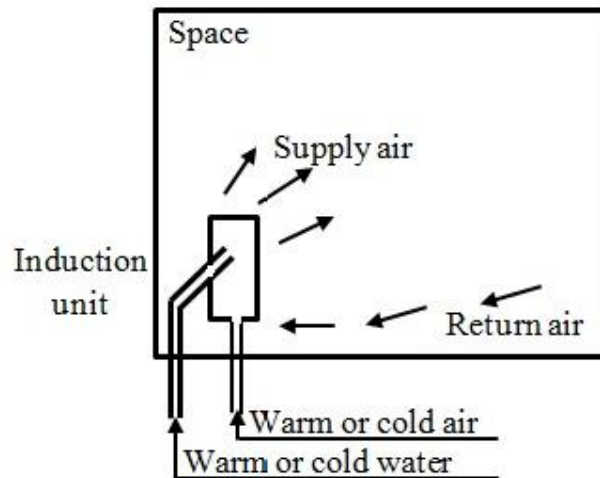


Figure 5-3 air- water system

#### 5-2-4 Multiple unit or unitary system [Direct expansion system]

A self-contained compact unit with the conditioned space consisting of minimum elements  
Include:-

##### 5-2-4-1 Window type

##### 5-2-4-2 Split unit :-

- a- Wall type fan coil unit
- b- Floor/ceiling fan coil unit
- c- Cassette fan coil unit
- d- Free standing decorative unit
- E- low/medium/high static duct air handling unit
- f- Top discharge condensing units

##### 5-2-4-3 Packaged air-conditioner

### 5-3 Cleaning of Air (Filtration)

#### 5-3-1 Operating characteristics:-

There are three operating characteristics that distinguish the various types of air cleaners . These are:-

- 1-Efficiency
- 2- Air flow resistance
- 3- The dust holding capacity

### **5-3-2 Contaminants:-**

Atmospheric contaminants Fall into four classes:- Solid , liquid , gaseous and organic.

- 1- Dusts:-these are solid particles.
- 2- Fumes: - these also are solid particles but formed in different way from dusts.
- 3- Smokes: - smokes may be regarded as small solid partielees
- 4- Mists and fogs: - They are both air borne droplets which are liquid at normal temperature and pressure.
- 5- Vapors and gases: - They are substances which are in the gaseous phase at normal temperature and pressure.
- 6- Organic particles: - The commonest of these are bacteria, pollen, the spores of fungi and viruses.

### **5-3-3Air filters types:-**

#### **5-3-3-1 viscous filters:**

- a- cell type
- b- automatic type

#### **5-3-3-2 Dry filters**

- a- cell type
- b- Automatic type

#### **5-3-3-3 Electric filters (figure 5-4)**

#### **5-3-3-4 Wet filters (figure 5-5)**

#### **5-3-3-5 Centrifugal collectors (figure 5-6)**

#### **5-3-3-6 Adsorption filters**

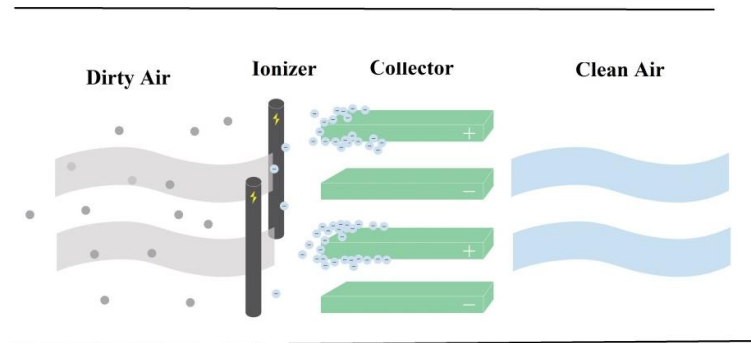


Figure 5- 4 Electrical air filters

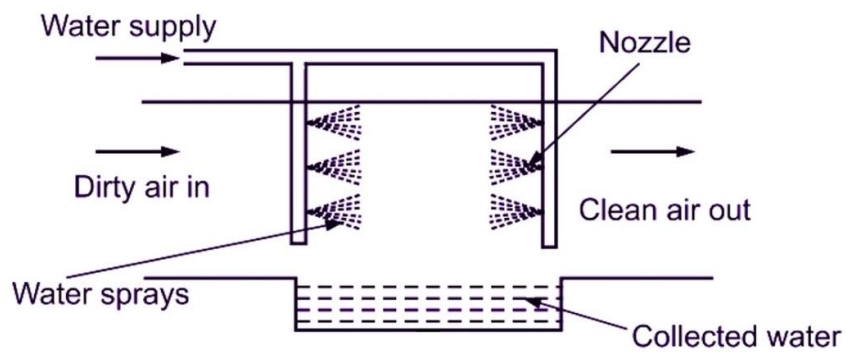


Figure 5- 5 wet air filters

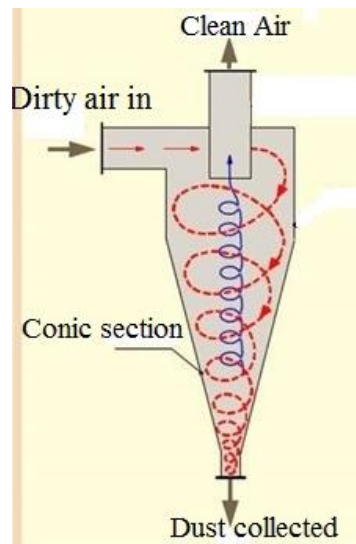


Figure 5-6 Centrifugal collectors air filter

Q1/ What are the types of heating, ventilating and Air-conditioning (H.V.A.C) system.

Q2/ What are the operating characteristics that distinguish the various types of air cleaners.

Q3/ what are the Atmospheric contaminants.

## References

W. P. Jones, *Air conditioning application and design*. Routledge, 2012.

B. J. Burley and others, “An update on ANSI/ASHRAE standard 62.1,” *Ashrae J.*, vol. 64, no. 9, pp. 28–30, 2022.

V. V. P. Bharathi, A. Kodliwad, B. A. Kumar, and V. V. N. Deepth, “Design of air conditioning system for residential/office building,” 2017.

W. T. Grondzik, *Air-conditioning system design manual*. Elsevier, 2007.

J. Watt, *Evaporative air conditioning handbook*. Springer Science & Business Media, 2012.

A. R. Chandra and R. C. Arora, *Refrigeration and air conditioning*. PHI Learning Pvt. Ltd., 2012.